

Exhibit 8



ADAM LABORATORIES, INC.

3807 PASADENA AVENUE, SUITE 190

SACRAMENTO, CA 95821

PHONE: (916) 979-9250

FAX: (916) 979-9251

Asbestos Report

Claim#: n/a

Date: October 22, 2019

Client: County of Lake

Site: 2810 Merced St
Nice, Ca

The site above contains ACM (Asbestos Containing Material). Handling, removing, or disposing of ACM must be performed in accordance with Local AQMD, State, and Federal Regulations (CCR & CFR) by a Licensed Asbestos Abatement Contractor.

OSHA requires that levels down to a tenth of percent (0.1%) of ACM can be removed only by a DOSH Licensed Asbestos Abatement Contractor with trained personnel holding valid asbestos worker certification, and proper PPE (Personal Protection Equipment). Work must be in accordance with State and Federal Law (Cal/OSHA and EPA). All other building material containing asbestos greater than one percent (>1%) is regulated waste according to Environmental Protection Agency. Below are approximate quantities of >1% asbestos containing material found on site:

- Non-friable (NESHAP Category I) Asbestos Containing Material (Penetration roofing mastic): Approx. 675 Sq ft.

The samples were collected by a State OSHA Certified "Site Surveillance Technician" and/or "Asbestos Consultant" under Adam Laboratories Inc (in accordance with Rule 902 Section 401.3). The location of ACM, quantity, percent, friability, type of asbestos, and date sampled can be found on the attached analytical lab report number 19AB2594 An Asbestos Abatement Plan can be provided by request, if so please contact us at the number provided in the letterhead.

Approved by,

Greg Candelario, Certified Asbestos Consultant (DOSH #08-4441)

This document is filed under Lab Identification Number 19ABR2594



ADAM LABORATORIES INC.

3807 Pasadena Ave. Ste., 190
Sacramento, CA 95821
Fax: (916) 979-9251
Phone: (916) 979-9250

Lab #: 19AB2594

Date Sampled: 10/22/2019

Date Analyzed: 10/22/2019

Sampled By: Greg Candelario

Analyzed By: Greg Candelario

ASSESSMENT AND ANALYSIS OF BULK ASBESTOS BY POLARIZED LIGHT MICROSCOPY (PLM) EPA 600/M4 METHOD

CLIENT: County of Lake

SITE: 2810 Merced St
Nice, Ca

CLAIM# n/a

No.	LAYERS	AREA FT ²	LOCATION	DESCRIPTION	I.D.	RACM	RESULT
1	2	*	Ext wall - NE	insulation	Glass and Cellulose Fibers		NAD
2	2	*	Livingroom ceiling - NE	insulation	Glass and Cellulose Fibers		NAD
3	2	*	Room 1 - SW ceiling	insulation	Glass and Cellulose Fibers		NAD
4	2	*	Kitchen ceiling - SE	insulation	Glass and Cellulose Fibers		NAD
5	5	*	Extension room - NW wall	joint comp/tape/paper/gyp/paint	Cellulose Fibers		NAD
6	5	*	Extension room - SW wall	joint comp/tape/paper/gyp/paint	Cellulose Fibers		NAD
7	2	*	Extension room - NW area wall	texture coat w/paint	Cellulose Fibers		NAD
8	2	*	Extension room - SW area wall	texture coat w/paint	Cellulose Fibers		NAD
9	2	*	Room 1 - NE area ceiling	ceiling slat (brown)	Cellulose Fibers		NAD
10	2	*	Livingroom ceiling - NW	ceiling slat (white)	Cellulose Fibers		NAD
11	2	*	Room 2 ceiling - NW	joint comp/tape/paper/gyp/paint	Cellulose Fibers		NAD
12	5	*	Room 2 ceiling - SW	texture coat w/paint	Cellulose Fibers		NAD
13	2	*	Room 2 ceiling - NE	texture coat w/paint	Cellulose Fibers		NAD
14	2	*	Kitchen floor - E area	sheet vinyl	Cellulose Fibers		NAD
15	2	*	Hall floor - center	sheet vinyl	Cellulose Fibers		NAD
16	2	*	Bathroom floor - center	sheet vinyl	Cellulose Fibers		NAD
17	2	*	Livingroom - N wall	insulation	Glass and Cellulose Fibers		NAD
18	2	*	Water heater space	insulation	Glass and Cellulose Fibers		NAD
19	2	675	E roof penetration	mastic	chrysotile - 5-8%		Non-friable Asbestos

LEGEND

NAD = Non Asbestos Detected. DL = detection limit: <1% asbestos (trace).

I.D. = fiber identification and/or asbestos type - percent.

Friable Asbestos = NESHAP RACM (Regulated Asbestos Containing Material): can be crumbled, pulverized or reduced to powder by hand pressure.


Non-friable Asbestos = NESHAP Category I material (resilient floor covering, vinyl floor tile, asphalt roofing products, packings and gaskets that cannot be rendered airborne by hand pressure) and/or NESHAP Category II material (all other non-friable asbestos containing material). Note that because of age or treatment, Category I and Category II materials, can be, and/or have the potential to become RACM.

RACM = NESHAP Regulated Asbestos Containing Material is all Friable ACM (>1% asbestos), including some conditions of Non-friable Category I & II ACM. NESHAP = US EPA National Emissions Standards for Hazardous Air Pollutants

APPROVED BY:

Greg Candelario, Lab Director
Certified Asbestos Consultant
CAL/OSHA: 08-4441

Analytical results represent the analysis of samples collected by ADAM Laboratories INC. This report is generated at the request and for the exclusive use of the person or entity (client) named on such report. Results, reports or copies will not be released to a third party without written request from the client. Sample(s) will be retained for a period of twelve months for possible future analytical verification, after which, the sample(s) will be disposed of according to all state and federal guidelines. ADAM Laboratories Inc. is a participant in the BAPAT (Bulk Asbestos Proficiency Analytical Testing) quality assurance program by AIHA (American Industrial Hygiene Association).

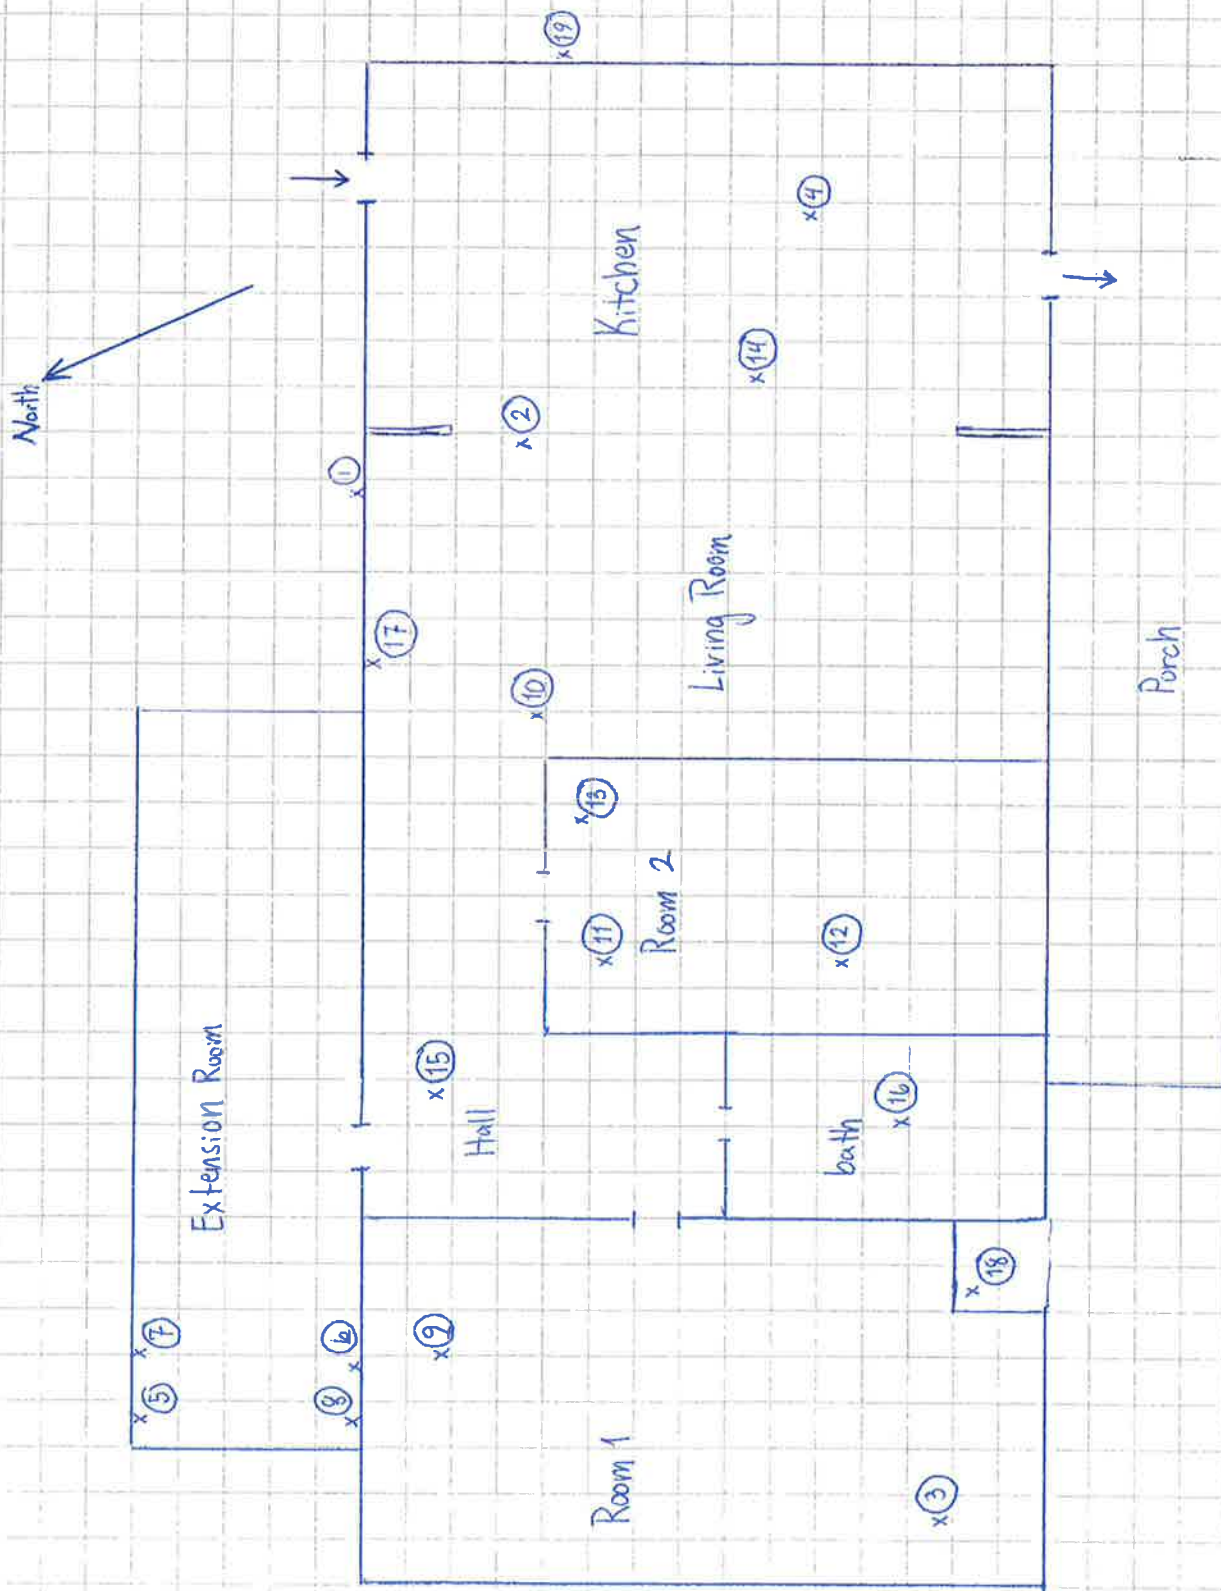



ADAM Laboratories Inc.
3807 PASADENA AVE., SUITE 190
SACRAMENTO, CA 95821

INVOICE:

30212

Date: 10/23/2019

BILL TO:

county of Lake
Marcus Beltramo
707-263-2390
Marcus.Beltramo@lakecountyca.gov

PROJECT
2810 Merced St Nice, CA
CLAIM NUMBER or P.O. NUMBER
N/A

Billing Contact/Phone

TERMS

Net 30

Lab Numbers	Description	Service Dates	Quantity	Rate	Amount
19AB2594	Asbestos Sample Collection, Analysis & Report	10/22/2019	1	850.00	850.00

For questions regarding this invoice, please call (916) 979-9250
Federal Taxpayer Identification Number: 55-0853369
info@adamlabs.com

TOTAL: \$850.00

CREDIT CARD INFORMATION:
(Visa - Mastercard - American Express)

Name on card: _____

Card# - Expiration Date - 3-digit code #: _____

Mailing Address: _____

Signature: _____