

WATER AVAILABILITY ANALYSIS

HIGHLAND FARMS, LP

7634 Highland Springs Road

Lakeport, CA 95453

APNs 007-006-40, 007-006-34, 007-006-35, 007-006-27, 007-006-41, 007-057-01, 007-057-02

TABLE OF CONTENTS

Project Overview 1

Estimated Water Demand..... 1

 Cannabis Cultivation Water Demand 2

 Cannabis Process Water Demand 3

 Domestic Water Demand..... 3

Total Water Demand & Peak Demand..... 4

Estimated Average Annual Groundwater Recharge 5

 Water Availability 6

Well Interference and Drawdown..... 6

Conclusion 8

LIST OF ENCLOSURES

- Enclosure A: Overall Site Map
- Enclosure B: Well Logs and Yield Tests
- Enclosure C: NOAA Climate Normals for Clearlake, CA
- Enclosure D: Well Drawdown Calculation Tables

PROJECT OVERVIEW

Highland Farms, LP, located at 7634 Highland Springs Road in Lakeport, CA is a proposed cannabis cultivation and processing facility. Highland Farms (Facility) operations will take place on several adjacent parcels (APN 007-006-34, -35, and -40). Several additional adjacent parcels are owned by the Facility and will be considered in this report (Enclosure A). These additional parcels are not proposed to have cultivation or processing facilities installed on them at this time. The Facility is located approximately 6.5 miles south of the city of Lakeport and 5 miles southwest of the city of Kelseyville. The surrounding area is hill range that is bordered by Highland Creek to the south and Highland Springs Reservoir to the east. This area of Lake County is contained within the Big Valley inventory unit of Lake County as defined by the 2006 *Lake County Inventory and Analysis* report, however the area is not located within an identified groundwater basin, so groundwater hydrogeology characteristics are unknown. Water availability estimates will therefore be conservatively limited to estimated surface recharge capabilities only. A low recharge rate will be used to compensate for the lack of site-specific recharge and storage capacities. The cumulative impact area is assumed to follow the topology of the surrounding area (Enclosure A).

The Facility is being requested by Lake County to evaluate water demands and sources to meet the requirements of its emergency drought ordinance (Ordinance 3106, dated July 27, 2021). Summit Engineering has prepared the following Water Availability Analysis to demonstrate that the water consumption associated with the proposed Facility's operations do not exceed conservative estimates of the water production capabilities of the project area and therefore should not negatively impact other users in the impact area.

The Facility's water demand is supplied by three onsite wells (Table 1). Well logs and 4-hour yield tests for each well are included in Enclosure B. Yield testing resulted in an estimated flow rate of 75 gpm, 129 gpm, and 132 gpm for Wells 1-3, respectively. Well 1 recovered to within 13 feet of its starting level within 45 minutes of stopping its pump. Wells 2 and 3 recovered to their starting level within 15 minutes of stopping their respective pumps. The total combined flow for the well is 336 gpm, which is expected to meet the domestic, cultivation, and landscape irrigation demands of the Facility.

Table 1. Existing well capacities.

| Well Name | Primary Use | Well Depth (ft) | Pump Depth (ft) | Status | Capacity (gpm) |
|-----------|---------------------------------|-----------------|-----------------|--------|----------------|
| Well 1 | Domestic/Cultivation/Irrigation | 180 | 160 | Active | 75 |
| Well 2 | Domestic/Cultivation/Irrigation | 140 | 100 | Active | 129 |
| Well 3 | Domestic/Cultivation/Irrigation | 200 | 160 | Active | 132 |

ESTIMATED WATER DEMAND

Estimated water uses on the property are based on the following:

- Cannabis cultivation water demand,
- Cannabis processing water demand,
- Domestic water demand associated with employees and visitors,

Fire suppression demand is not accounted for in this analysis as fire flows are typically supplied by a separate water system and are not regularly used. Landscape demand is also not considered for this site as there are currently no plans for ornamental vegetation.

CANNABIS CULTIVATION WATER DEMAND

Water demand estimates for cannabis cultivation vary greatly between available studies, but per the Facility's Farm Management Plan, the assumed average water demand is 30 inches per acre per year (2.5 acre-feet per acre per year, or 814,620 gallons per acre per year). This demand is multiplied by the planted acreage and a canopy coverage percent (Table 2). For outdoor cultivation at the Facility, the canopy coverage is estimated to be 40%. Nursery demand is estimated in with the same method but uses a canopy coverage of 70%.

Once properly permitted, the Facility plans to cultivate up to 12.34 acres of outdoor vegetation, use a 29,600 square foot (0.68 acres) area as a year-round greenhouse nursery, and a 47,270 square foot area (1.09 acres) as a year-round greenhouse. This corresponds to 12.3 acre-feet per year of outdoor water demand, 1.19 acre-feet per year of greenhouse nursery water demand, and 1.91 acre-feet per year of greenhouse water demand for a total estimated cultivation water demand of 15.44 acre-feet per year (5,030,278 gallons per year). This demand will vary by month depending on which crop is being grown at the time. An estimated monthly distribution of demand is summarized in Table 2.

Table 2. Estimated monthly cultivation water demand.

| Month | Outdoor Cultivation Demand (gallons) | Nursery Cultivation Demand (gallons) | Greenhouse Cultivation Demand (gallons) | Total Cultivation Demand (gallons) |
|------------------------|--------------------------------------|--------------------------------------|---|------------------------------------|
| January | 0 | 32,313 | 51,796 | 84,110 |
| February | 0 | 32,313 | 51,796 | 84,110 |
| March | 0 | 32,313 | 51,796 | 84,110 |
| April | 250,384 | 32,313 | 51,796 | 334,494 |
| May | 482,595 | 32,313 | 51,796 | 566,705 |
| June | 583,975 | 32,313 | 51,796 | 668,085 |
| July | 667,436 | 32,313 | 51,796 | 751,546 |
| August | 667,436 | 32,313 | 51,796 | 751,546 |
| September | 667,436 | 32,313 | 51,796 | 751,546 |
| October | 482,595 | 32,313 | 51,796 | 566,705 |
| November | 219,105 | 32,313 | 51,796 | 303,215 |
| December | 0 | 32,313 | 51,796 | 84,110 |
| Total (gallons) | 4,020,964 | 387,759 | 621,555 | 5,030,278 |
| Total (ac-ft) | 12.34 | 1.19 | 1.91 | 15.44 |

CANNABIS PROCESS WATER DEMAND

Water demand for cannabis processing is assumed to be required for two proposed processing buildings. Process water will be used for washdowns, ice use, and other cleaning activities. This water demand is anticipated to occur year-round and total to approximately 3.76 acre-feet of water per year (Table 3). Estimates for this demand are based on data from the 2012 water consumption survey performed by the United States Energy Information Administration's Commercial Building Energy Consumption Survey. This is a conservative estimate as there is likely some overlap between this data and the domestic water demand estimate mentioned in the section below.

Table 3. Estimated monthly process water demand.

| Month | Processing Building I Demand (gallons) | Processing Building E Demand (gallons) | Total Process Demand (gallons) |
|------------------------|--|--|--------------------------------|
| January | 66,000 | 36,000 | 102,000 |
| February | 66,000 | 36,000 | 102,000 |
| March | 66,000 | 36,000 | 102,000 |
| April | 66,000 | 36,000 | 102,000 |
| May | 66,000 | 36,000 | 102,000 |
| June | 66,000 | 36,000 | 102,000 |
| July | 66,000 | 36,000 | 102,000 |
| August | 66,000 | 36,000 | 102,000 |
| September | 66,000 | 36,000 | 102,000 |
| October | 66,000 | 36,000 | 102,000 |
| November | 66,000 | 36,000 | 102,000 |
| December | 66,000 | 36,000 | 102,000 |
| Total (gallons) | 792,000 | 432,000 | 1,224,000 |
| Total (ac-ft) | 2.43 | 1.33 | 3.76 |

DOMESTIC WATER DEMAND

The domestic water demand of the Facility is estimated based on a maximum of 22 full-time employees, up to 30 part-time employees, and 5 visitors per week. Sanitary sewage (SS) generation and facility domestic water demand are expected to be equivalent, and as such, prescribed sewage flows are used to calculate estimated domestic water demand. Daily water demand per employee is assumed to be 78 gallons per day and is based on a 2006 County report title *Lake County Water Demand Forecast*. This daily demand per employee is significantly larger than anticipated demands (15 gallons per employee per day); however, the larger value is used for conservatism. The annual domestic water demand for the Facility is estimated to be 3.46 acre-ft per year (Table 4).

Table 4. Estimated facility domestic water demand.

| Use Type | Number (people/day) | Water Demand (gal/person) | Daily Demand (gal/day) | Frequency (times/year) | Annual Demand (gal/year) |
|--|------------------------|------------------------------|---------------------------|---------------------------|-----------------------------|
| Full-Time Employees ¹ | 22 | 78 ⁴ | 1716 | 365 | 626,340 |
| Part-Time Employees ² | 30 | 78 ⁴ | 2340 | 214 | 500,760 |
| Visitors ³ | 5 | 3 | 15 | 12 | 180 |
| Total Annual Domestic Water Demand (gallons) | | | | | 1,127,280 |
| Total Annual Domestic Water Demand (ac-ft/year) | | | | | 3.46 |
| Average Daily Water Use (GPD) | | | | | 3,088 |

Notes:

1. Peak number of employees assumed every day to be conservative.
2. Part time employees are assumed to be onsite between April-October.
3. Assumed to have up to five visitors per month.
4. Employee water demand assumed to be 78 GPCD per the Lake County Water Demand Forecast (CDM 2006)

TOTAL WATER DEMAND & PEAK DEMAND

The total water demand for the Facility is conservatively estimated to be 22.7 acre-ft/year (Table 5). Cannabis cultivation is the highest demand source for the Facility, accounting for over 68% of total anticipated demand.

Table 5. Total Projected Annual Water Demand

| Source of Demand | Average Gallons per Day | Gallons per Year | Acre-ft per Year |
|--------------------------|-------------------------|------------------|------------------|
| Cannabis Cultivation Use | 13,782 | 5,030,278 | 15.44 |
| Cannabis Process Use | 3,353 | 1,224,000 | 3.76 |
| Domestic Use | 3,088 | 1,127,280 | 3.46 |
| Total | 20,223 | 7,381,558 | 22.7 |

Peak demand for the facility is assumed to occur during peak growing season and is estimated to be 61,480 gallons per day (Table 6). Assuming a normal facility operating schedule of 8 hours per day, the minutely-demand of the peak day is estimated to be approximately 128 gpm. Wells 2 or 3 are anticipated to be capable of sustaining this demand alone. In total, the facility has access to up to 336 gpm of groundwater via its three wells. The facility is proposed to initially have twenty-eight 5,000-gallon poly-tanks for a total storage capacity of 140,000 gallons, which would provide up to two days of peak flow. Once use permit UP20-96 is approved, the facility would install three engineered tanks totaling 192,000 gallons.

Table 6. Estimated peak day water demand.

| Use Type | Use Source | Number (unit/day) | Water Demand (gal/unit) | Daily Demand (gal/day) |
|-------------|---------------------|----------------------|----------------------------|---------------------------|
| Domestic | Full-Time Employees | 22 | 78 | 1,716 |
| | Part-Time Employees | 30 | 78 | 2,340 |
| | Visitors | 5 | 3 | 15 |
| | Subtotal | | | 4,080 |
| Cultivation | Facility Operations | - | 25,100 ¹ | 25,100 |
| | Subtotal | | | 25,100 |
| Process | Facility Operations | - | 3,400 ² | 3,400 |
| | Subtotal | | | 3,400 |
| Total | | | | 32,580 |

1. Peak cultivation demand is assumed to be the average day demand during the peak month. Peak month demand is divided by 30 days.

2. Peak process demand is assumed to be the average day demand during the peak month. Peak month demand is divided by 30 days.

ESTIMATED AVERAGE ANNUAL GROUNDWATER RECHARGE

An estimate of the average annual groundwater recharge for the Facility is being provided as an estimate of available water. To be conservative, only potential surface water recharge will be evaluated since groundwater transfers in and out of the local aquifer are unknown. The project consists of seven parcels, with the largest being approximately 269 acres of brushed hill lands. The total area across all project parcels is estimated to be 507 acres, with only approximately 4.6 acres being impervious (Table 7). The remaining area is primarily native vegetation which is typically conducive to groundwater recharge through precipitation.

Precipitation recharge estimates rely on simple water balance principles with the recharge mechanic of interest being infiltration of rainwater to the groundwater table. Precipitation recharge rates are highly variable and depend on area geology, topology, and groundwater hydrology. Due to these characteristics being unknown at the Facility, the precipitation recharge rate is assumed to be minimal (5% of total annual precipitation).

The average annual precipitation is estimated to be 29.8 inches/year from precipitation normals for Clearlake from the National Oceanic and Atmospheric Administration (NOAA) climate database for the period between 1991-2020 (Enclosure C). The Clearlake station is the closest NOAA monitoring station to the Facility.

Utilizing the project parcel's pervious area, assumed rainfall recharge fraction of 5%, and normal annual precipitation, the anticipated annual recharge for a typical year would be calculated as:

$$\begin{aligned}
 \text{Typical Annual Recharge} &= \left(\text{Pervious Area (ac)} * \text{Precipitation} \left(\frac{\text{ft}}{\text{year}} \right) * \text{Recharge Fraction (\%)} \right) \\
 &= \left(502.6 \text{ acres} * \frac{29.8 \frac{\text{in}}{\text{year}}}{12 \frac{\text{in}}{\text{ft}}} * 5\% \right) \\
 &= 62.5 \frac{\text{acre-ft}}{\text{year}}
 \end{aligned}$$

Table 7. Estimated groundwater recharge per project parcel.

| Parcel APN | Total Area (ac) | Est. Impervious Area (ac) ³ | Recharge Area (ac) | Avg. Annual Precipitation (in) ⁴ | Aquifer Recharge Rate (%) ⁵ | Est. Annual Recharge (ac-ft) |
|----------------------------|-----------------|--|--------------------|---|--|------------------------------|
| 007-006-34 ^{1, 2} | 44.4 | 0.85 | 43.55 | 29.86 | 5% | 5.4 |
| 007-006-35 ^{1, 2} | 30.7 | 3.24 | 27.46 | | | 3.4 |
| 007-006-40 ^{1, 2} | 39.2 | 0.5 | 38.7 | | | 4.8 |
| 007-006-41 | 39.1 | 0 | 39.1 | | | 4.9 |
| 007-006-27 | 269.1 | 0 | 269.1 | | | 33.5 |
| 007-057-01 | 79.9 | 0 | 79.9 | | | 9.9 |
| 007-057-02 | 4.8 | 0 | 4.8 | | | 0.6 |
| Total | 507 | 4.59 | 502.61 | 29.86 | 5% | 62.5 |

Notes

1. Parcels 007-006-34, -35, and -40 are currently proposed to be the only developed parcels of the project.
2. Parcels 007-006-34, -35, and -40 have approved permits for three new groundwater wells.
3. Site impervious area estimate includes area of proposed buildings, roads, and impervious areas visible from aerial imagery.
4. Average annual precipitation for Clearlake based on NOAA Climate Normals for 1991-2020 (NOAA 2021).
5. Aquifer recharge rate of precipitation assumed to be minor for conservatism.

WATER AVAILABILITY

The total estimated water demand for the Facility is 22.7 acre-feet per year, which represents 36% of the conservatively estimated 62.5 acre-feet per year of groundwater recharge potential for the project site. The water demand of the Facility does not surpass its estimated precipitation recharge potential which suggests that there would be no impacts to other facilities in the cumulative impact area.

WELL INTERFERENCE AND DRAWDOWN

A well drawdown analysis is included for reference and is intended to estimate any interference between onsite wells, offsite wells, or springs that could affect their supply capacity due to water usage (Enclosure D). The objective of this analysis is to determine if any well (existing or in the future) installed outside of the Facility parcel could be affected by the drawdown of the Facility's well. The analysis was performed for each active well onsite (Wells 1-3). Aquifer characteristics such as thickness, specific storage, and hydraulic conductivity are estimated due to unknown site conditions. Specific storage and hydraulic conductivity are varied to provide a range of potential drawdown effects.

- Method

Using the Theis equation the groundwater drawdown from the property well to the edge of the parcel was determined. The assumed closest distance that any neighboring well could be located is the edge of the parcel. Due to the limited data on the aquifer, values that would yield a conservative drawdown estimate were used.

Assumptions:

- Aquifer Thickness of 100 ft.
- Hydraulic Conductivity low range of 10 to 30 ft/day
- Specific Storage range of 1.5×10^{-5} to 3.1×10^{-4} (1/ft)

The Theis equation can be seen below along with an example calculation.

$$\text{Theis Equation: Drawdown} = \frac{\text{Flow}}{(4\pi \times \text{Transmissivity})} \times W(u)$$

$$W(u) = \int_u^{\infty} \frac{1}{\omega} e^{-\omega} d\omega$$

$$u = \frac{(\text{Distance}^2 \times \text{Specific Storage})}{(4 \times \text{Transmissivity} \times \text{Time})}$$

$$\text{Transmissivity} = \text{Hydraulic Conductivity} \times \text{Aquifer Thickness}$$

Example for the domestic well drawdown effect on possible wells on adjacent properties:

$$u = \frac{(500 \text{ ft})^2 \times (1.50 \times 10^{-5})}{4 \times 10 \frac{\text{ft}}{\text{day}} \times 100 \text{ ft} \times 1 \text{ day}} = 9.38 \times 10^{-4}$$

With this value of u, $W(u) = 6.40$

$$\text{Drawdown} = \frac{75 \frac{\text{gal}}{\text{min}} \times 0.1337 \frac{\text{cuft}}{\text{gal}} \times 1,440 \frac{\text{min}}{\text{day}}}{4\pi \times 10 \frac{\text{ft}}{\text{day}} \times 100 \text{ ft}} \times 6.40 = 7.35 \text{ ft}$$

The table below shows a summary of the worst-case scenario of drawdown results for the onsite wells. The radius of influence for Well 1 is set as 500 feet, but the nearest property line bordering a parcel not owned by the facility is greater than 500 feet. More detailed tables can be found in Enclosure D.

Table 8. Well Drawdown Calculations

| | Well Flow Rate (gpm) | Radius of Influence (ft) | Estimated Drawdown (ft) |
|--------|-------------------------|-----------------------------|----------------------------|
| Well 1 | 75 | 500 | 7.35 |
| Well 2 | 129 | 175 | 14.6 |
| Well 3 | 132 | 265 | 13.3 |

Results

Using estimates for aquifer thickness, specific storage, and hydraulic conductivity, the Facility's wells are not expected to produce a drawdown greater than 15 feet within their respective radii of influence. Wells 2 and 3 produce larger drawdowns due to their pump rate and their proximity to a parcel boundary that is not owned by the Facility. Per the California Department of Water Resources' Well Completion Report Map Application, there does not appear to be any existing wells that are not owned by the Facility in the project area. Well completion reports for each of the Facility wells are available from the Well Completion Report Map Application so future well drilling by adjacent parcels will have access to their information for pump installation purposes.

CONCLUSION


The total annual water demand of Highland Farms for cultivation, process, and domestic uses is projected to be 22.7 acre-feet per year, which is below the conservatively estimated parcel groundwater recharge rate of 62.5 acre-feet per year. The parcel groundwater recharge rate is a conservative estimate that only accounts for groundwater recharge via precipitation infiltration. Other sources of recharge are possible which may result in greater recharge rates than what is estimated. The water use by Highland Farms is not expected to negatively impact other users in the cumulative impact area. The anticipated peak day water demand for the parcel is estimated to be met by the existing 336 gpm of onsite well capacity. The proposed use of the well pumps is not anticipated to cause drawdown issues for neighboring properties should they install wells in the future.

Highland Farms, LP
Water Availability Analysis
January 20, 2022

SUMMIT ENGINEERING, INC.
Project No.: 2021038

ENCLOSURE A

OVERALL SITE PLAN AND CUMULATIVE IMPACT AREA WELL LOCATION MAP

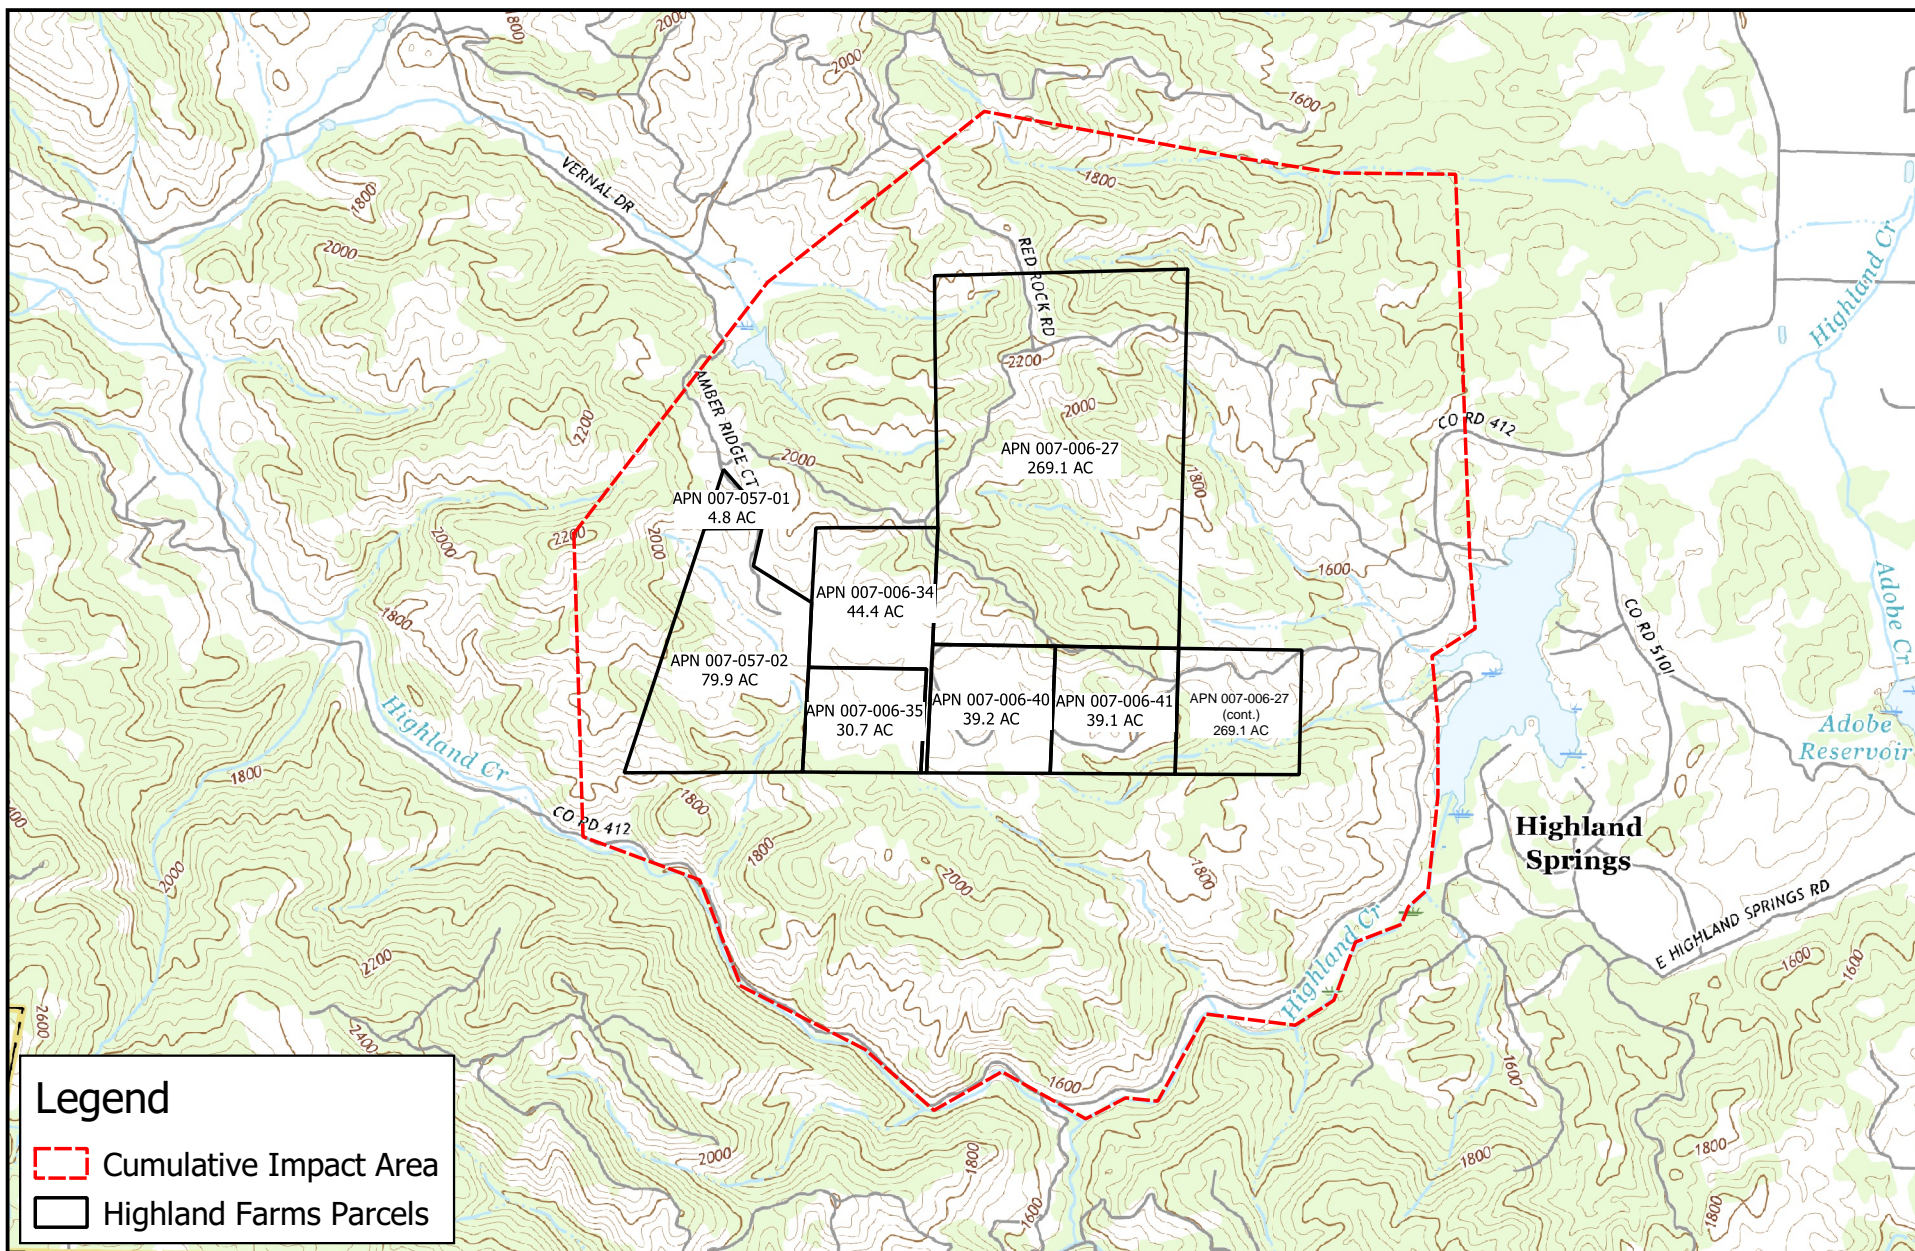


Legend

- Cumulative Impact Area
- Highland Farms Parcels



0 1000 2000 3000 ft



PROJECT NO. 2021038

DATE 10/11/2021


BASEMAP USGS Topo

Overall Site Plan




HIGHLAND FARMS
7522 HIGHLAND SPRINGS RD
LAKEPORT, CA
APN 007-006-35

SUMMIT

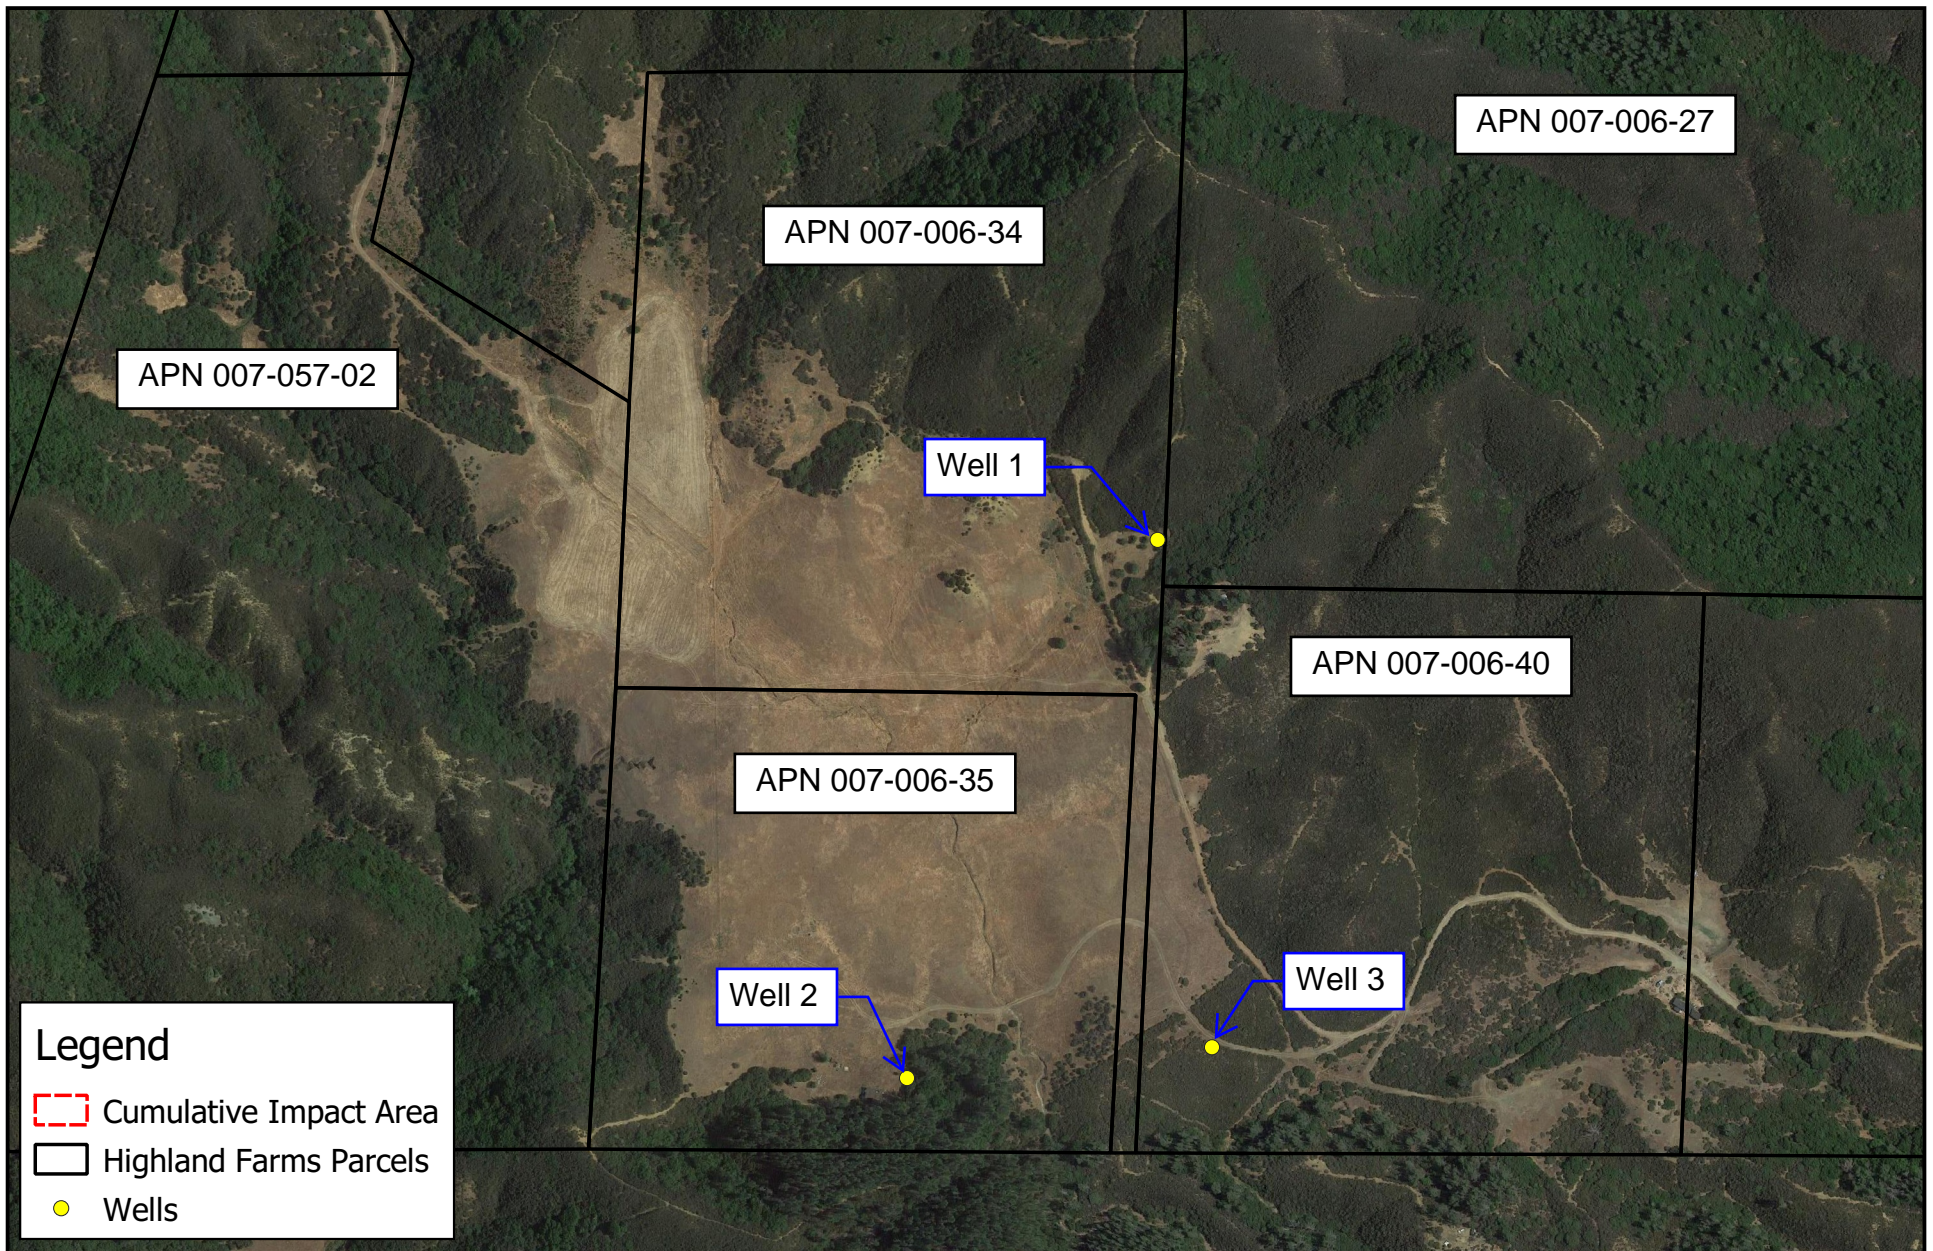SUMMIT ENGINEERING, INC.
 463 Aviation Blvd., Suite 200
 Santa Rosa, CA 95403 707.527.0775




Legend

-  Cumulative Impact Area
-  Highland Farms Parcels
-  Wells



0 225 450 675 ft



PROJECT NO. 2021038
DATE 12/28/2021
BASEMAP USGS Topo

Overall Site Plan - Well Locations

HIGHLAND FARMS
7522 HIGHLAND SPRINGS RD
LAKEPORT, CA
APN 007-006-35

SUMMIT 
SUMMIT ENGINEERING, INC.
463 Aviation Blvd., Suite 200
Santa Rosa, CA 95403 707.527.0775

Highland Farms, LP
Water Availability Analysis
January 20, 2022

SUMMIT ENGINEERING, INC.
Project No.: 2021038

ENCLOSURE B

WELL LOGS AND YIELD TESTS

State of California
Well Completion Report
 Form DWR 188 Submitted 11/30/2020
 WCR2020-016453

Owner's Well Number _____ Date Work Began 11/13/2020 Date Work Ended 11/17/2020
 Local Permit Agency Lake County Health Services Department - Environmental Health Division
 Secondary Permit Agency _____ Permit Number WE-5448 Permit Date 09/23/2020

| Well Owner (must remain confidential pursuant to Water Code 13752) | | Planned Use and Activity | |
|--|--|--------------------------|--|
| Name <u>Patrick McMurray</u> | Activity <u>New Well</u> | | |
| Mailing Address <u>44017 County Road 17</u> | Planned Use <u>Water Supply Irrigation - Agriculture</u> | | |
| City <u>Woodland</u> State <u>Ca</u> Zip <u>95776</u> | | | |

| Well Location | | | |
|--|---|---------------------------------------|--|
| Address <u>7408 Highland Springs RD</u> | | APN <u>007-006-341</u> | |
| City <u>Lakeport</u> | Zip <u>95453</u> | Township <u>13 N</u> | |
| County <u>Lake</u> | Range <u>10 W</u> | | |
| Latitude <u>38</u> <u>56</u> <u>36.41</u> <u>N</u> | Longitude <u>-122</u> <u>55</u> <u>37.54</u> <u>W</u> | Section <u>25</u> | |
| Dec. Lat. <u>38.9434472</u> | Dec. Long. <u>-122.9270944</u> | Baseline Meridian <u>Mount Diablo</u> | |
| Vertical Datum _____ | Horizontal Datum <u>WGS84</u> | Ground Surface Elevation _____ | |
| Location Accuracy <u>20 Ft</u> | Location Determination Method _____ | Elevation Accuracy _____ | |
| | | Elevation Determination Method _____ | |

| Borehole Information | | Water Level and Yield of Completed Well | |
|--|---|---|--|
| Orientation <u>Vertical</u> Specify _____ | Depth to first water _____ (Feet below surface) | | |
| Drilling Method <u>Direct Rotary</u> Drilling Fluid <u>Bentonite</u> | Depth to Static _____ | | |
| Total Depth of Boring <u>180</u> Feet | Water Level <u>37</u> (Feet) Date Measured <u>11/17/2020</u> | | |
| Total Depth of Completed Well <u>180</u> Feet | Estimated Yield* <u>50</u> (GPM) Test Type <u>Air Lift</u> | | |
| | Test Length <u>2</u> (Hours) Total Drawdown <u>131</u> (feet) | | |
| | *May not be representative of a well's long term yield. | | |

| Geologic Log - Free Form | | |
|------------------------------------|-----|----------------------------|
| Depth from Surface Feet to Feet | | Description |
| 0 | 43 | Soil and gravel |
| 43 | 79 | Shale |
| 79 | 180 | Sandstone and green quartz |

| Casings | | | | | | | | | | |
|----------|------------------------------------|-----|-------------|----------|--|----------------------------|------------------------------|--------------|------------------------------|-------------|
| Casing # | Depth from Surface Feet to Feet | | Casing Type | Material | Casings Specificatons | Wall Thickness (inches) | Outside Diameter (inches) | Screen Type | Slot Size if any (inches) | Description |
| 1 | 0 | 120 | Blank | PVC | OD: 5.563 in. SDR: 21 Thickness: 0.265 in. | 0.265 | 5.563 | | | |
| 1 | 120 | 180 | Screen | PVC | OD: 5.563 in. SDR: 21 Thickness: 0.265 in. | 0.265 | 5.563 | Milled Slots | 0.032 | |

| Annular Material | | | | | |
|------------------------------------|-----|-------------|------------------------|------------------|--------------|
| Depth from Surface Feet to Feet | | Fill | Fill Type Details | Filter Pack Size | Description |
| 0 | 20 | Bentonite | Non Hydrated Bentonite | | Surface Seal |
| 20 | 180 | Filter Pack | Other Gravel Pack | 3/8 | Pea Gravel |

Other Observations:

| Borehole Specifications | | |
|------------------------------------|-----|----------------------------|
| Depth from Surface Feet to Feet | | Borehole Diameter (inches) |
| 0 | 20 | 11 |
| 20 | 180 | 7.875 |

Certification Statement

I, the undersigned, certify that this report is complete and accurate to the best of my knowledge and belief

Name

WEEKS DRILLING AND PUMP CO

Person, Firm or Corporation

PO BOX 176

SEBASTOPOL

CA

94573-

Address

City

State

Zip

Signed

electronic signature received

C-57 Licensed Water Well Contractor

11/30/2020

Date Signed

177681

C-57 License Number

| Attachments |
|--------------------------------|
| 007-006-341.pdf - Location Map |

DWR Use Only

CSG #

State Well Number

Site Code

Local Well Number

N

W

Latitude Deg/Min/Sec

Longitude Deg/Min/Sec

TRS:

APN:

Amber Ridge Court

1250'

10011'

340' X 100'

7408 HIGHLAND SPRINGS RD
LAKEPORT CA 95453
007-006-341



GPS:
New Well - 38°56'36.41"N / 122°55'37.54"W

APN:007-006-341



| TITLE | | DESCRIPTION |
|----------|----------|---|
| New Well | | 7408 Highland Springs Road Lakeport Ca 95453 |
| DATE | 9/5/2020 | PAGE 1 of 1 |

CAL-TECH PUMP WELL & WATER TREATMENT

P.O. Box 1261
Middletown, CA 95461
Ph. 707-987-4488

www.cal-techpump.com
State License # 923640
Fax. 707-987-4411

Well Inspection Log

For: Cultivo Inc.

Site: 7527 Highland Springs Rd.

Project:

Escrow #:

Ph:

Email:

Start Date: 12/15/2020

Technician: Joe

[illegible]

Water Quality Sample Taken: No
Pump Broke Suction During Test: No

Total Pumping Time: 4 Hrs.
Total Volume Pumped: 18,200 Gallons
Well Yield For Duration Of Test: 75.8 Gallons per minute

NOTES & RECOMMENDATIONS:

Set 10 HP 60S100 to 160' on 2" sch. 80 drop pipe. Well casing is above grade and is covered with a 5" PVC cap. We ran the Test for four hours, the water level drew down to 92', doing approx. 75 GPM.

State of California
Well Completion Report
 Form DWR 188 Submitted 12/8/2021
 WCR2021-015562

Owner's Well Number Well #2 Date Work Began 10/09/2021 Date Work Ended 10/17/2021
 Local Permit Agency Lake County Health Services Department - Environmental Health Division
 Secondary Permit Agency _____ Permit Number We5737ag Permit Date 09/20/2021

| Well Owner (must remain confidential pursuant to Water Code 13752) | | | | Planned Use and Activity | |
|--|--|-----------------|--|--|--|
| Name <u>LAKE CO DEVELOPMENT CO,</u> | | | | Activity <u>New Well</u> | |
| Mailing Address <u>12762 Hwy 29</u> | | | | Planned Use <u>Water Supply Irrigation - Agriculture</u> | |
| City <u>Lower Lake</u> | | State <u>Ca</u> | | Zip <u>65457</u> | |

| Well Location | | | | | | | | | |
|--|--|---|--|-------------------------------------|--|---------------------------------------|--|--|--|
| Address <u>7522 Highland springs RD</u> | | | | | | APN <u>007006351</u> | | | |
| City <u>Lakeport</u> | | Zip <u>95457</u> | | County <u>Lake</u> | | Township <u>13 N</u> | | | |
| Latitude <u>38</u> <u>56</u> <u>32.6457</u> <u>N</u> | | Longitude <u>-122</u> <u>55</u> <u>47.6814</u> <u>W</u> | | Range <u>10 W</u> | | Section <u>25</u> | | | |
| Deg. Min. Sec. | | Deg. Min. Sec. | | Deg. Min. Sec. | | Baseline Meridian <u>Mount Diablo</u> | | | |
| Dec. Lat. <u>38.9424016</u> | | | | Dec. Long. <u>-122.9299115</u> | | Ground Surface Elevation _____ | | | |
| Vertical Datum _____ | | | | Horizontal Datum <u>WGS84</u> | | Elevation Accuracy _____ | | | |
| Location Accuracy _____ | | | | Location Determination Method _____ | | Elevation Determination Method _____ | | | |

| Borehole Information | | | | Water Level and Yield of Completed Well | | | |
|---|--|---------------------------|--|---|--|--|--|
| Orientation <u>Vertical</u> | | Specify _____ | | Depth to first water <u>75</u> (Feet below surface) | | | |
| Drilling Method <u>Downhole Rotary Hammer</u> | | Drilling Fluid <u>Air</u> | | Depth to Static _____ | | | |
| Total Depth of Boring <u>140</u> Feet | | | | Water Level <u>52</u> (Feet) Date Measured _____ | | | |
| Total Depth of Completed Well <u>140</u> Feet | | | | Estimated Yield* <u>50</u> (GPM) Test Type _____ | | | |
| | | | | Test Length _____ (Hours) Total Drawdown _____ (feet) | | | |
| *May not be representative of a well's long term yield. | | | | | | | |

| Geologic Log - Lite | | | | | |
|------------------------------------|-----|---------------|----------------|------------------|----------------------|
| Depth from Surface Feet to Feet | | Material Type | Material Color | Material Texture | Material Description |
| 0 | 50 | Clay | | | |
| 50 | 75 | Rock | Green | Soft | |
| 75 | 80 | Rock | Green | Fractured | |
| 80 | 95 | Rock | Green | | |
| 95 | 140 | Rock | Green | Fractured | |

| Casings | | | | | | | | | | |
|----------|------------------------------------|-----|-------------|------------------|-----------------------|----------------------------|------------------------------|--------------|------------------------------|-------------|
| Casing # | Depth from Surface Feet to Feet | | Casing Type | Material | Casings Specificatons | Wall Thickness (inches) | Outside Diameter (inches) | Screen Type | Slot Size if any (inches) | Description |
| 1 | 0 | 100 | Blank | Low Carbon Steel | Grade: ASTM A53 | 0.188 | 6.625 | | | |
| 1 | 100 | 140 | Screen | Low Carbon Steel | Grade: ASTM A53 | 0.188 | 6.625 | Milled Slots | 0.25 | |

| Annular Material | | | | | |
|------------------------------------|-----|------------|-----------------------------|------------------|-------------|
| Depth from Surface Feet to Feet | | Fill | Fill Type Details | Filter Pack Size | Description |
| 0 | 52 | Cement | Portland Cement/Neat Cement | | |
| 52 | 140 | Other Fill | See description. | | None |

Other Observations:

| Borehole Specifications | | |
|------------------------------------|-----|----------------------------|
| Depth from Surface Feet to Feet | | Borehole Diameter (inches) |
| 0 | 52 | 14 |
| 52 | 140 | 7 |

Certification Statement

I, the undersigned, certify that this report is complete and accurate to the best of my knowledge and belief

Name

J W MORRISON INC

Person, Firm or Corporation

P O BOX 1617

LAYTONVILLE

CA

95454

Address

City

State

Zip

Signed

electronic signature received

C-57 Licensed Water Well Contractor

12/08/2021

Date Signed

970906

C-57 License Number

DWR Use Only

CSG #

State Well Number

Site Code

Local Well Number

N

W

Latitude Deg/Min/Sec

Longitude Deg/Min/Sec

TRS:

APN:

Form DWR 188 rev. 12/19/2017

Page 2 of 2

NOT A LEGAL DOCUMENT

NOT A LEGAL DOCUMENT

NOT A LEGAL DOCUMENT

Source: Esri, DeLorme, GeoEye, "Terrestrial" GeoGraphics, CNES/Airbus DS, USDA, USGS, AeroGRID, IGN, and the GIS User Community, Lake County, IL Dept. Lake County, I.T.



Highland Springs

Web AppBuilder for ArcGIS



Print Date: 7/28/2021

All parcel boundaries are *approximate*. Discrepancies in acreage, shape and location are common. This map is not the legal survey document to be used in single site determinations. Consult your deed for a legal parcel description.

Date: Dec. 17-2021

CONTRACTOR

BUYER / OWNER

J W MORRISON, INC.

LAKE COUNTY DEVELOPMENT CO., LLC.

State License # 970906 "General A, C57, D49

Autumn Karcey Mgr.

Mailing Address: P.O. Box 1617

(530) 379-8588

Physical Address: 47901 Woodruff Road,

12762 HWY 29

Laytonville, Calif. 95454

Lower Lake, Ca. 95457

Email jwmorrisoninc@hughes.net

autumn@lakecodevelopment.com

Office (707) 984-8858 Fax (707) 984-8815

Site Address: 7522 Highland Springs Rd. Lakeport, CA. 95453 APN#007-006-351

| Well Depth | Well Size | Water Static | Pump Size | Total Draw Down | Test Length |
|------------|-----------|--------------|-------------|-----------------|-------------|
| 140' | 6" Steel | 54' | 100GPM 10HP | 74' | 4 Hours |

| Date | Time | Water Level | Gal Per Minute | Water Meter | Comments |
|------------|---------|-------------|----------------|-------------|-------------------|
| 12/17/2021 | 10:20PM | 54 | | 35300 | Initial Draw Down |
| | 10:30PM | 73 | 133 | 36400 | Start of Test |
| | 10:45PM | 73 | 126 | 38400 | |
| | 11:00PM | 73 | 140 | 40300 | |
| | 11:15PM | 73 | 120 | 42400 | |
| | 11:30PM | 73 | 126 | 44200 | |
| | 11:45PM | 73 | 140 | 46100 | |
| 12/18/2021 | 12:00AM | 73 | 120 | 47900 | |
| | 12:15AM | 73 | 160 | 49500 | |
| | 12:30AM | 74 | 126 | 51900 | |
| | 12:45AM | 74 | 133 | 53800 | |
| | 1:00AM | 74 | 126 | 55800 | |
| | 1:15AM | 74 | 126 | 57700 | |
| | 1:30AM | 74 | 133 | 59600 | |
| | 1:45AM | 74 | 126 | 61600 | |
| | 2:00AM | 74 | 126 | 63500 | |
| | 2:15AM | 74 | 126 | 65400 | |
| | 2:30AM | 74 | 126 | 67300 | |
| | 2:43AM | 54 | | | Recovery |

| Total Gallons Pumped | Estimated Yield Overall | Water Quality Test Taken |
|----------------------|-------------------------|--------------------------|
| 32000 | 129 GPM | No |

*May not be representative of a well's long term yield

Comments: Set 10 Hp 100 GPM pump at 100' on 2 1/2 inch galvanized pipe. Ran pump on 70kw generator. Water was clear.

State of California
Well Completion Report
 Form DWR 188 Submitted 12/7/2021
 WCR2021-015478

Owner's Well Number Well #3 Date Work Began 11/01/2021 Date Work Ended 11/06/2021
 Local Permit Agency Lake County Health Services Department - Environmental Health Division
 Secondary Permit Agency _____ Permit Number We5758 Permit Date 10/25/2021

| Well Owner (must remain confidential pursuant to Water Code 13752) | | | Planned Use and Activity | |
|--|--|--|--|--|
| Name <u>LEVENTHAT REALTY HIGHLAND SPRINGS LLC,</u> | | | Activity <u>New Well</u> | |
| Mailing Address <u>505 Martainsville Rd</u> | | | Planned Use <u>Water Supply Irrigation - Agriculture</u> | |
| City <u>Basking Ridge</u> State <u>NJ</u> Zip <u>07920</u> | | | | |

| Well Location | | | | | | | | | |
|--|--|---|--|---------------------------------------|--|--------------------------------------|--|--|--|
| Address <u>7634 Highland springs</u> | | | | | | APN <u>007006401</u> | | | |
| City <u>Lakeport</u> | | Zip <u>95453</u> | | County <u>Lake</u> | | Township <u>13 N</u> | | | |
| Latitude <u>38</u> <u>56</u> <u>28.7091</u> <u>N</u> | | Longitude <u>-122</u> <u>55</u> <u>29.5802</u> <u>W</u> | | Range <u>10 W</u> | | Section <u>25</u> | | | |
| Deg. Min. Sec. | | Deg. Min. Sec. | | Baseline Meridian <u>Mount Diablo</u> | | Ground Surface Elevation _____ | | | |
| Dec. Lat. <u>38.9413081</u> | | Dec. Long. <u>-122.9248834</u> | | Elevation Accuracy _____ | | Elevation Determination Method _____ | | | |
| Vertical Datum _____ | | Horizontal Datum <u>WGS84</u> | | | | | | | |
| Location Accuracy _____ | | Location Determination Method _____ | | | | | | | |

| Borehole Information | | | | Water Level and Yield of Completed Well | | | |
|---|--|---|--|---|--|-----------------------------|--|
| Orientation <u>Vertical</u> | | Specify _____ | | Depth to first water <u>65</u> (Feet below surface) | | | |
| Drilling Method <u>Downhole Rotary Hammer</u> | | Drilling Fluid <u>Air</u> | | Depth to Static _____ | | | |
| Total Depth of Boring <u>200</u> Feet | | Total Depth of Completed Well <u>200</u> Feet | | Water Level _____ (Feet) | | Date Measured _____ | |
| | | | | Estimated Yield* <u>50</u> (GPM) | | Test Type <u>Air Lift</u> | |
| | | | | Test Length <u>0.5</u> (Hours) | | Total Drawdown _____ (feet) | |
| *May not be representative of a well's long term yield. | | | | | | | |

| Geologic Log - Lite | | | | | |
|------------------------------------|-----|---------------|----------------|------------------|----------------------|
| Depth from Surface Feet to Feet | | Material Type | Material Color | Material Texture | Material Description |
| 0 | 40 | Rock | Brown | | |
| 40 | 80 | Rock | Green | | |
| 80 | 125 | Rock | Black | | |
| 125 | 160 | Rock | Green | | |
| 160 | 175 | Rock | Light Brown | | |
| 175 | 200 | Rock | Green | | |

| Casings | | | | | | | | | | |
|----------|------------------------------------|-----|-------------|------------------|-----------------------|----------------------------|------------------------------|--------------|------------------------------|-------------|
| Casing # | Depth from Surface Feet to Feet | | Casing Type | Material | Casings Specificatons | Wall Thickness (inches) | Outside Diameter (inches) | Screen Type | Slot Size if any (inches) | Description |
| 1 | 0 | 160 | Blank | Low Carbon Steel | Grade: ASTM A53 | 0.188 | 6.625 | | | |
| 1 | 160 | 200 | Screen | Low Carbon Steel | Grade: ASTM A53 | 188 | 6.625 | Milled Slots | 0.25 | |

| Annular Material | | | | | |
|------------------------------------|-----|------------|-----------------------------|------------------|-------------|
| Depth from Surface Feet to Feet | | Fill | Fill Type Details | Filter Pack Size | Description |
| 0 | 52 | Cement | Portland Cement/Neat Cement | | |
| 52 | 200 | Other Fill | See description. | | None |

Other Observations:

| Borehole Specifications | | |
|------------------------------------|-----|----------------------------|
| Depth from Surface Feet to Feet | | Borehole Diameter (inches) |
| 0 | 52 | 14 |
| 52 | 200 | 7 |

| Certification Statement | | | | |
|--|--------------------------------------|--------------------|---------------------|--------------|
| I, the undersigned, certify that this report is complete and accurate to the best of my knowledge and belief | | | | |
| Name <u>J W MORRISON INC</u> | | | | |
| Person, Firm or Corporation | | | | |
| <u>P O BOX 1617</u> | | <u>LAYTONVILLE</u> | <u>CA</u> | <u>95454</u> |
| Address | | City | State | Zip |
| Signed | <u>electronic signature received</u> | <u>12/07/2021</u> | <u>970906</u> | |
| | C-57 Licensed Water Well Contractor | Date Signed | C-57 License Number | |

| DWR Use Only | | | | | | | | | | | |
|----------------------|-------------------|--|--|--|-----------|-----------------------|--|-------------------|--|--|---|
| CSG # | State Well Number | | | | Site Code | | | Local Well Number | | | |
| | | | | | | | | | | | |
| | | | | | N | | | | | | W |
| Latitude Deg/Min/Sec | | | | | | Longitude Deg/Min/Sec | | | | | |
| TRS: | | | | | | | | | | | |
| APN: | | | | | | | | | | | |

NOT A LEGAL DOCUMENT

NOT A LEGAL DOCUMENT



Highland Springs

Web AppBuilder for ArcGIS



Print Date: 7/28/2021

All parcel boundaries are *approximate*. Discrepancies in acreage, shape and location are common. This map is not the legal survey document to be used in single site determinations. Consult your deed for a legal parcel description.

Date: Dec. 17-2021

CONTRACTOR

BUYER / OWNER

J W MORRISON, INC.

LAKE COUNTY DEVELOPMENT CO., LLC.

State License # 970906 "General A, C57, D49

Autumn Karcey Mgr.

Mailing Address: P.O. Box 1617

(530) 379-8588

Physical Address: 47901 Woodruff Road,

12762 HWY 29

Laytonville, Calif. 95454

Lower Lake, Ca. 95457

Email jwmorrisoninc@hughes.net

autumn@lakecodevelopment.com

Office (707) 984-8858 Fax (707) 984-8815

Site Address: 7634 Highland Springs Rd. Lakeport, CA. 95453 APN#007-006-401

| Well Depth | Well Size | Water Static | Pump Size | Total Draw Down | Test Length |
|------------|-----------|--------------|-------------|-----------------|-------------|
| 200' | 6" Steel | 52' | 100GPM 10HP | 109' | 4 Hours |

| Date | Time | Water Level | Gal Per Minute | Water Meter | Comments |
|------------|--------|-------------|----------------|-------------|-------------------|
| 12/17/2021 | 3:30PM | 52 | 133 | 1400 | Initial Draw Down |
| | 3:45PM | 107 | 133 | 3400 | Start of Test |
| | 4:00PM | 107 | 133 | 5400 | |
| | 4:15PM | 107 | 133 | 7300 | |
| | 4:30PM | 107 | 126 | 9100 | |
| | 4:45PM | 108 | 120 | 10900 | |
| | 5:00PM | 108 | 126 | 12800 | |
| | 5:15PM | 108 | 126 | 14700 | |
| | 5:30PM | 109 | 126 | 16600 | |
| | 5:45PM | 109 | 126 | 18500 | |
| | 6:00PM | 109 | 120 | 20200 | |
| | 6:15PM | 109 | 133 | 22200 | |
| | 6:30PM | 109 | 120 | 24000 | |
| | 6:45PM | 109 | 126 | 25900 | |
| | 7:00PM | 109 | 126 | 27800 | |
| | 7:15PM | 109 | 126 | 29700 | |
| | 7:30PM | 109 | 120 | 31500 | |
| | 7:45PM | 109 | 126 | 33400 | |
| | 8:00PM | 109 | 126 | 35300 | |
| 12/17/2021 | 8:09PM | 52 | | | Recovery |

| Total Gallons Pumped | Estimated Yield Overall | Water Quality Test Taken |
|----------------------|-------------------------|--------------------------|
| 31900 | 132 GPM | No |

*May not be representative of a well's long term yield

Comments: Set 10 Hp 100 GPM pump at 160' on 2 1/2 inch galvanized pipe. Ran pump on 70kw generator. Water was clear.

Highland Farms, LP
Water Availability Analysis
January 20, 2022

SUMMIT ENGINEERING, INC.
Project No.: 2021038

ENCLOSURE C

NOAA CLIMATE NORMALS

U.S. Department of Commerce
National Oceanic & Atmospheric Administration
National Environmental Satellite, Data, and Information Service
Current Location: Elev: 1349 ft. Lat: 38.9239° N Lon: -122.5672° W
Station: **CLEARLAKE 4 SE, CA US USC00041806**

Summary of Monthly Normals
1991-2020
Generated on 09/21/2021

National Centers for Environmental Information
151 Patton Avenue
Asheville, North Carolina 28801

| Precipitation (in.) | | | | | | | | |
|---------------------|--------|---------------------|---------|---------|---------|--|-------|-------|
| | Totals | Mean Number of Days | | | | Precipitation Probabilities Probability that precipitation will be equal to or less than the indicated amount | | |
| | Means | Daily Precipitation | | | | Monthly Precipitation vs. Probability Levels | | |
| Month | Mean | >= 0.01 | >= 0.10 | >= 0.50 | >= 1.00 | 0.25 | 0.50 | 0.75 |
| 01 | 6.19 | 13.6 | 9.2 | 4.1 | 1.8 | 2.47 | 4.13 | 9.15 |
| 02 | 6.15 | 12.7 | 8.5 | 4.9 | 2.5 | 0.77 | 5.55 | 9.12 |
| 03 | 3.99 | 10.3 | 6.4 | 2.8 | 0.9 | 1.64 | 2.98 | 4.92 |
| 04 | 1.99 | 8.1 | 4.3 | 1.1 | 0.2 | 0.41 | 1.21 | 2.81 |
| 05 | 1.16 | 5.4 | 2.7 | 0.8 | 0.2 | 0.34 | 0.92 | 1.57 |
| 06 | 0.23 | 1.7 | 0.6 | 0.1 | 0.0 | 0.00 | 0.05 | 0.35 |
| 07 | 0.01 | 0.2 | 0.0 | 0.0 | 0.0 | 0.00 | 0.00 | 0.00 |
| 08 | 0.09 | 0.2 | 0.2 | 0.2 | 0.0 | 0.00 | 0.00 | 0.00 |
| 09 | 0.17 | 0.6 | 0.3 | 0.1 | 0.1 | 0.00 | 0.02 | 0.17 |
| 10 | 0.91 | 4.0 | 2.4 | 1.1 | 0.2 | 0.07 | 0.62 | 1.29 |
| 11 | 2.89 | 9.2 | 5.2 | 1.8 | 0.9 | 1.56 | 2.47 | 3.86 |
| 12 | 6.08 | 12.6 | 8.8 | 4.8 | 2.2 | 2.89 | 4.79 | 9.38 |
| Summary | 29.86 | 78.6 | 48.6 | 21.8 | 9.0 | 10.15 | 22.74 | 42.62 |

Empty or blank cells indicate data is missing or insufficient occurrences to compute value

Highland Farms, LP
Water Availability Analysis
January 20, 2022

SUMMIT ENGINEERING, INC.
Project No.: 2021038

ENCLOSURE D

WELL DRAWDOWN CALCULATION TABLES

| | | |
|--------------------------|--|--|
| SUMMIT ENGINEERING, INC. | Highland Farms Water Availability Well Drawdown Analysis Well 1 | PROJECT NO. 2021038 BY: JM CHK: GG |
|--------------------------|--|--|

Site Specific Parameters

| | |
|----------------------|------------------------------|
| Well Flow: | Low End Specific Storage: |
| 75 gpm | 1.50E-05 1/ft |
| Radius of Influence: | High End Specific Storage: |
| 500 ft | 3.10E-04 1/ft |
| Aquifer Thickness | Low Hydraulic Conductivity: |
| 100 ft | 10 ft/day |
| Pumping Time: | High Hydraulic Conductivity: |
| 1 day | 30 ft/day |

Theis Drawdown

| Scenario | Specific Storage (1/ft): | Hydraulic Conductivity (ft/day) | Theis u value (unitless): | u _a , rounded down (unitless): | u _b , rounded up (unitless): | W(u _a) | W(u _b) | W(u), interpolated | Theis s value | Drawdown (ft) |
|----------------|--------------------------|---------------------------------|---------------------------|---|---|--------------------|--------------------|--------------------|---------------|---------------|
| High S, Low h | 3.10E-04 | 10 | 1.94E-02 | 1.00E-02 | 2.00E-02 | 4.038 | 3.355 | 3.40 | 0.0203 | 3.90 |
| Low S, Low h | 1.50E-05 | 10 | 9.38E-04 | 9.00E-04 | 1.00E-03 | 6.437 | 6.332 | 6.40 | 0.0382 | 7.35 |
| High S, High h | 3.10E-04 | 30 | 6.46E-03 | 6.00E-03 | 7.00E-03 | 4.545 | 4.392 | 4.47 | 0.0089 | 1.71 |
| Low S, High h | 1.50E-05 | 30 | 3.13E-04 | 3.00E-04 | 4.00E-04 | 7.535 | 7.247 | 7.50 | 0.0149 | 2.87 |

Notes:

- 1) Four conditions (varying specific storage and hydraulic conductivity) are considered
- 2) Low specific storage and low hydraulic conductivity typically will result in max drawdown (highlighted in green)
- 3) Drawdowns greater than 10 ft typically indicate significant impacts
- 4) Assumes a full day of pumping instead of a typical 8-hour operating day

| | | |
|--------------------------|--|--|
| SUMMIT ENGINEERING, INC. | Highland Farms Water Availability Well Drawdown Analysis Well 2 | PROJECT NO. 2021038 BY: JM CHK: GG |
|--------------------------|--|--|

Site Specific Parameters

| | |
|----------------------|------------------------------|
| Well Flow: | Low End Specific Storage: |
| 129 gpm | 1.50E-05 1/ft |
| Radius of Influence: | High End Specific Storage: |
| 175 ft | 3.10E-04 1/ft |
| Aquifer Thickness | Low Hydraulic Conductivity: |
| 100 ft | 10 ft/day |
| Pumping Time: | High Hydraulic Conductivity: |
| 0.33 day | 30 ft/day |

Theis Drawdown

| Scenario | Specific Storage (1/ft): | Hydraulic Conductivity (ft/day) | Theis u value (unitless): | u_a , rounded down (unitless): | u_b , rounded up (unitless): | $W(u_a)$ | $W(u_b)$ | $W(u)$, interpolated | Theis s value | Drawdown (ft) |
|----------------|--------------------------|---------------------------------|---------------------------|----------------------------------|--------------------------------|----------|----------|-----------------------|---------------|---------------|
| High S, Low h | 3.10E-04 | 10 | 7.12E-03 | 7.00E-03 | 8.00E-03 | 4.392 | 4.259 | 4.38 | 0.0449 | 8.65 |
| Low S, Low h | 1.50E-05 | 10 | 3.45E-04 | 3.00E-04 | 4.00E-04 | 7.535 | 7.247 | 7.41 | 0.0760 | 14.64 |
| High S, High h | 3.10E-04 | 30 | 2.37E-03 | 2.00E-03 | 3.00E-03 | 5.639 | 5.235 | 5.49 | 0.0188 | 3.62 |
| Low S, High h | 1.50E-05 | 30 | 1.15E-04 | 1.00E-04 | 2.00E-04 | 8.633 | 7.94 | 8.53 | 0.0292 | 5.62 |

Notes:

- 1) Four conditions (varying specific storage and hydraulic conductivity) are considered
- 2) Low specific storage and low hydraulic conductivity typically will result in max drawdown (highlighted in green)
- 3) Drawdowns greater than 10 ft typically indicate significant impacts
- 4) Assumes a full day of pumping instead of a typical 8-hour operating day

| | | |
|--------------------------|--|--|
| SUMMIT ENGINEERING, INC. | Highland Farms Water Availability Well Drawdown Analysis Well 3 | PROJECT NO. 2021038 BY: JM CHK: GG |
|--------------------------|--|--|

Site Specific Parameters

| | |
|----------------------|------------------------------|
| Well Flow: | Low End Specific Storage: |
| 132 gpm | 1.50E-05 1/ft |
| Radius of Influence: | High End Specific Storage: |
| 265 ft | 3.10E-04 1/ft |
| Aquifer Thickness | Low Hydraulic Conductivity: |
| 100 ft | 10 ft/day |
| Pumping Time: | High Hydraulic Conductivity: |
| 0.33 day | 30 ft/day |

Theis Drawdown

| Scenario | Specific Storage (1/ft): | Hydraulic Conductivity (ft/day) | Theis u value (unitless): | u_a , rounded down (unitless): | u_b , rounded up (unitless): | $W(u_a)$ | $W(u_b)$ | $W(u)$, interpolated | Theis s value | Drawdown (ft) |
|----------------|--------------------------|---------------------------------|---------------------------|----------------------------------|--------------------------------|----------|----------|-----------------------|---------------|---------------|
| High S, Low h | 3.10E-04 | 10 | 1.63E-02 | 1.00E-02 | 2.00E-02 | 4.038 | 3.355 | 3.61 | 0.0379 | 7.29 |
| Low S, Low h | 1.50E-05 | 10 | 7.90E-04 | 7.00E-04 | 8.00E-04 | 6.688 | 6.555 | 6.57 | 0.0690 | 13.28 |
| High S, High h | 3.10E-04 | 30 | 5.44E-03 | 5.00E-03 | 6.00E-03 | 4.726 | 4.545 | 4.65 | 0.0163 | 3.13 |
| Low S, High h | 1.50E-05 | 30 | 2.63E-04 | 2.00E-04 | 3.00E-04 | 7.94 | 7.535 | 7.68 | 0.0269 | 5.18 |

Notes:

- 1) Four conditions (varying specific storage and hydraulic conductivity) are considered
- 2) Low specific storage and low hydraulic conductivity typically will result in max drawdown (highlighted in green)
- 3) Drawdowns greater than 10 ft typically indicate significant impacts
- 4) Assumes a full day of pumping instead of a typical 8-hour operating day

Highland Farms, LP
Water Availability Analysis
January 20, 2022

SUMMIT ENGINEERING, INC.
Project No.: 2021038

SUMMIT 
SUMMIT ENGINEERING, INC.
463 Aviation Blvd., Suite 200
Santa Rosa, CA 95403
707 527-0775
sfo@summit-sr.com