

160.00'

RECEIVED

APR 18 2017

Lake County
Environmental Health

APPROVED

LAKE COUNTY HEALTH DEPT.

Date: 18 APR 17

Environmental Health Specialist

300 gal wastewater system for Greasy Water Kitchen

ADDITIONAL INSPECTIONS REQUIRED PRIOR TO OCCUPANCY

N42d 05' 04" 6W
420.29'

(FLAT LOT)

Greasy Water Dump For Food Truck

GREASE INTERCEPTER UNIT 500 GAL

EXISTING BARN

BLACK WASTEWATER

30' MIN.
REPLACEMENT
INITIAL

1050 GAL. SEPTIC TANK

LEACH LINES

125' TOTAL
LEACH LINE

PROJECT SITE

297' +/-

320.00'

DIRT ACCESS ROAD

EXISTING
RESIDENCE

APPROXIMATE
WELL
LOCATION

441.00'

EXISTING DRIVEWAY

TO LAKEPORT

SODA BAY ROAD


PLOT PLAN 1" = 50 FT.

RECEIVED
APR 18 2017
Lake County
Environmental Health



- 300 gpd wastewater -
system for catering
kitchen


ADDITIONAL
INSPECTIONS
REQUIRED PRIOR
TO OCCUPANCY

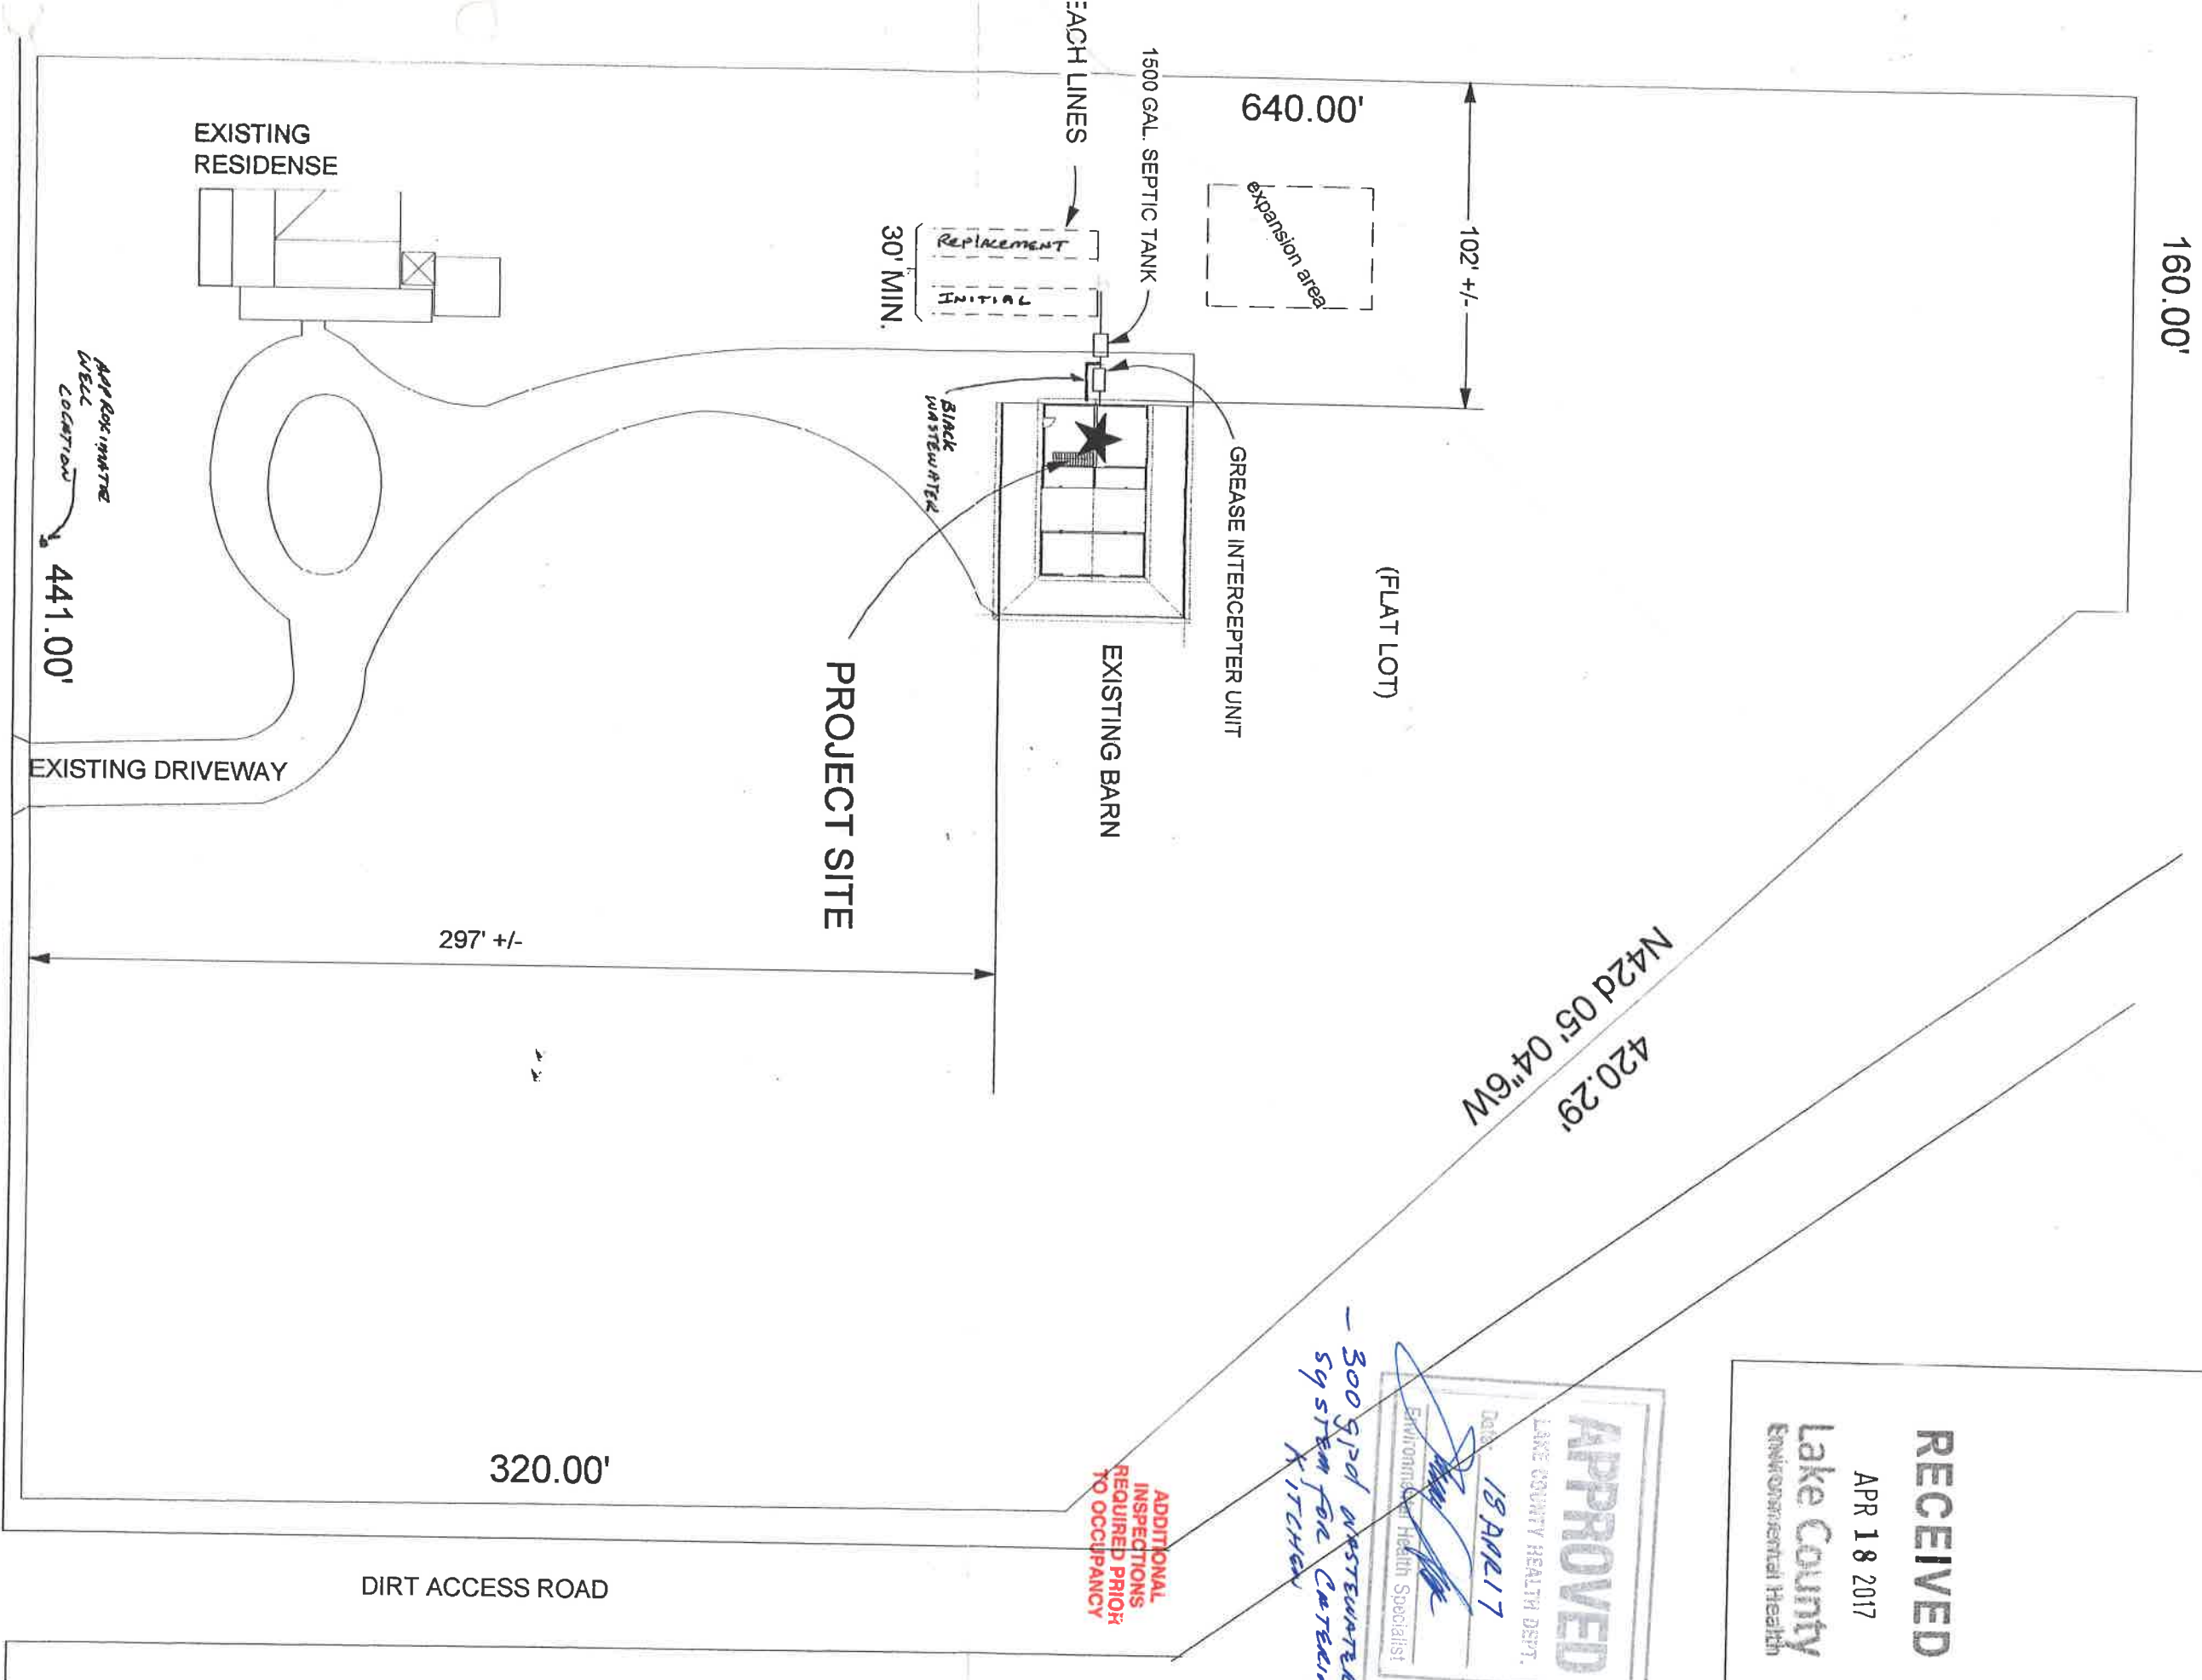

TO LAKEPORT

SODA BAY ROAD

PLOT PLAN 1" = 50 FT.

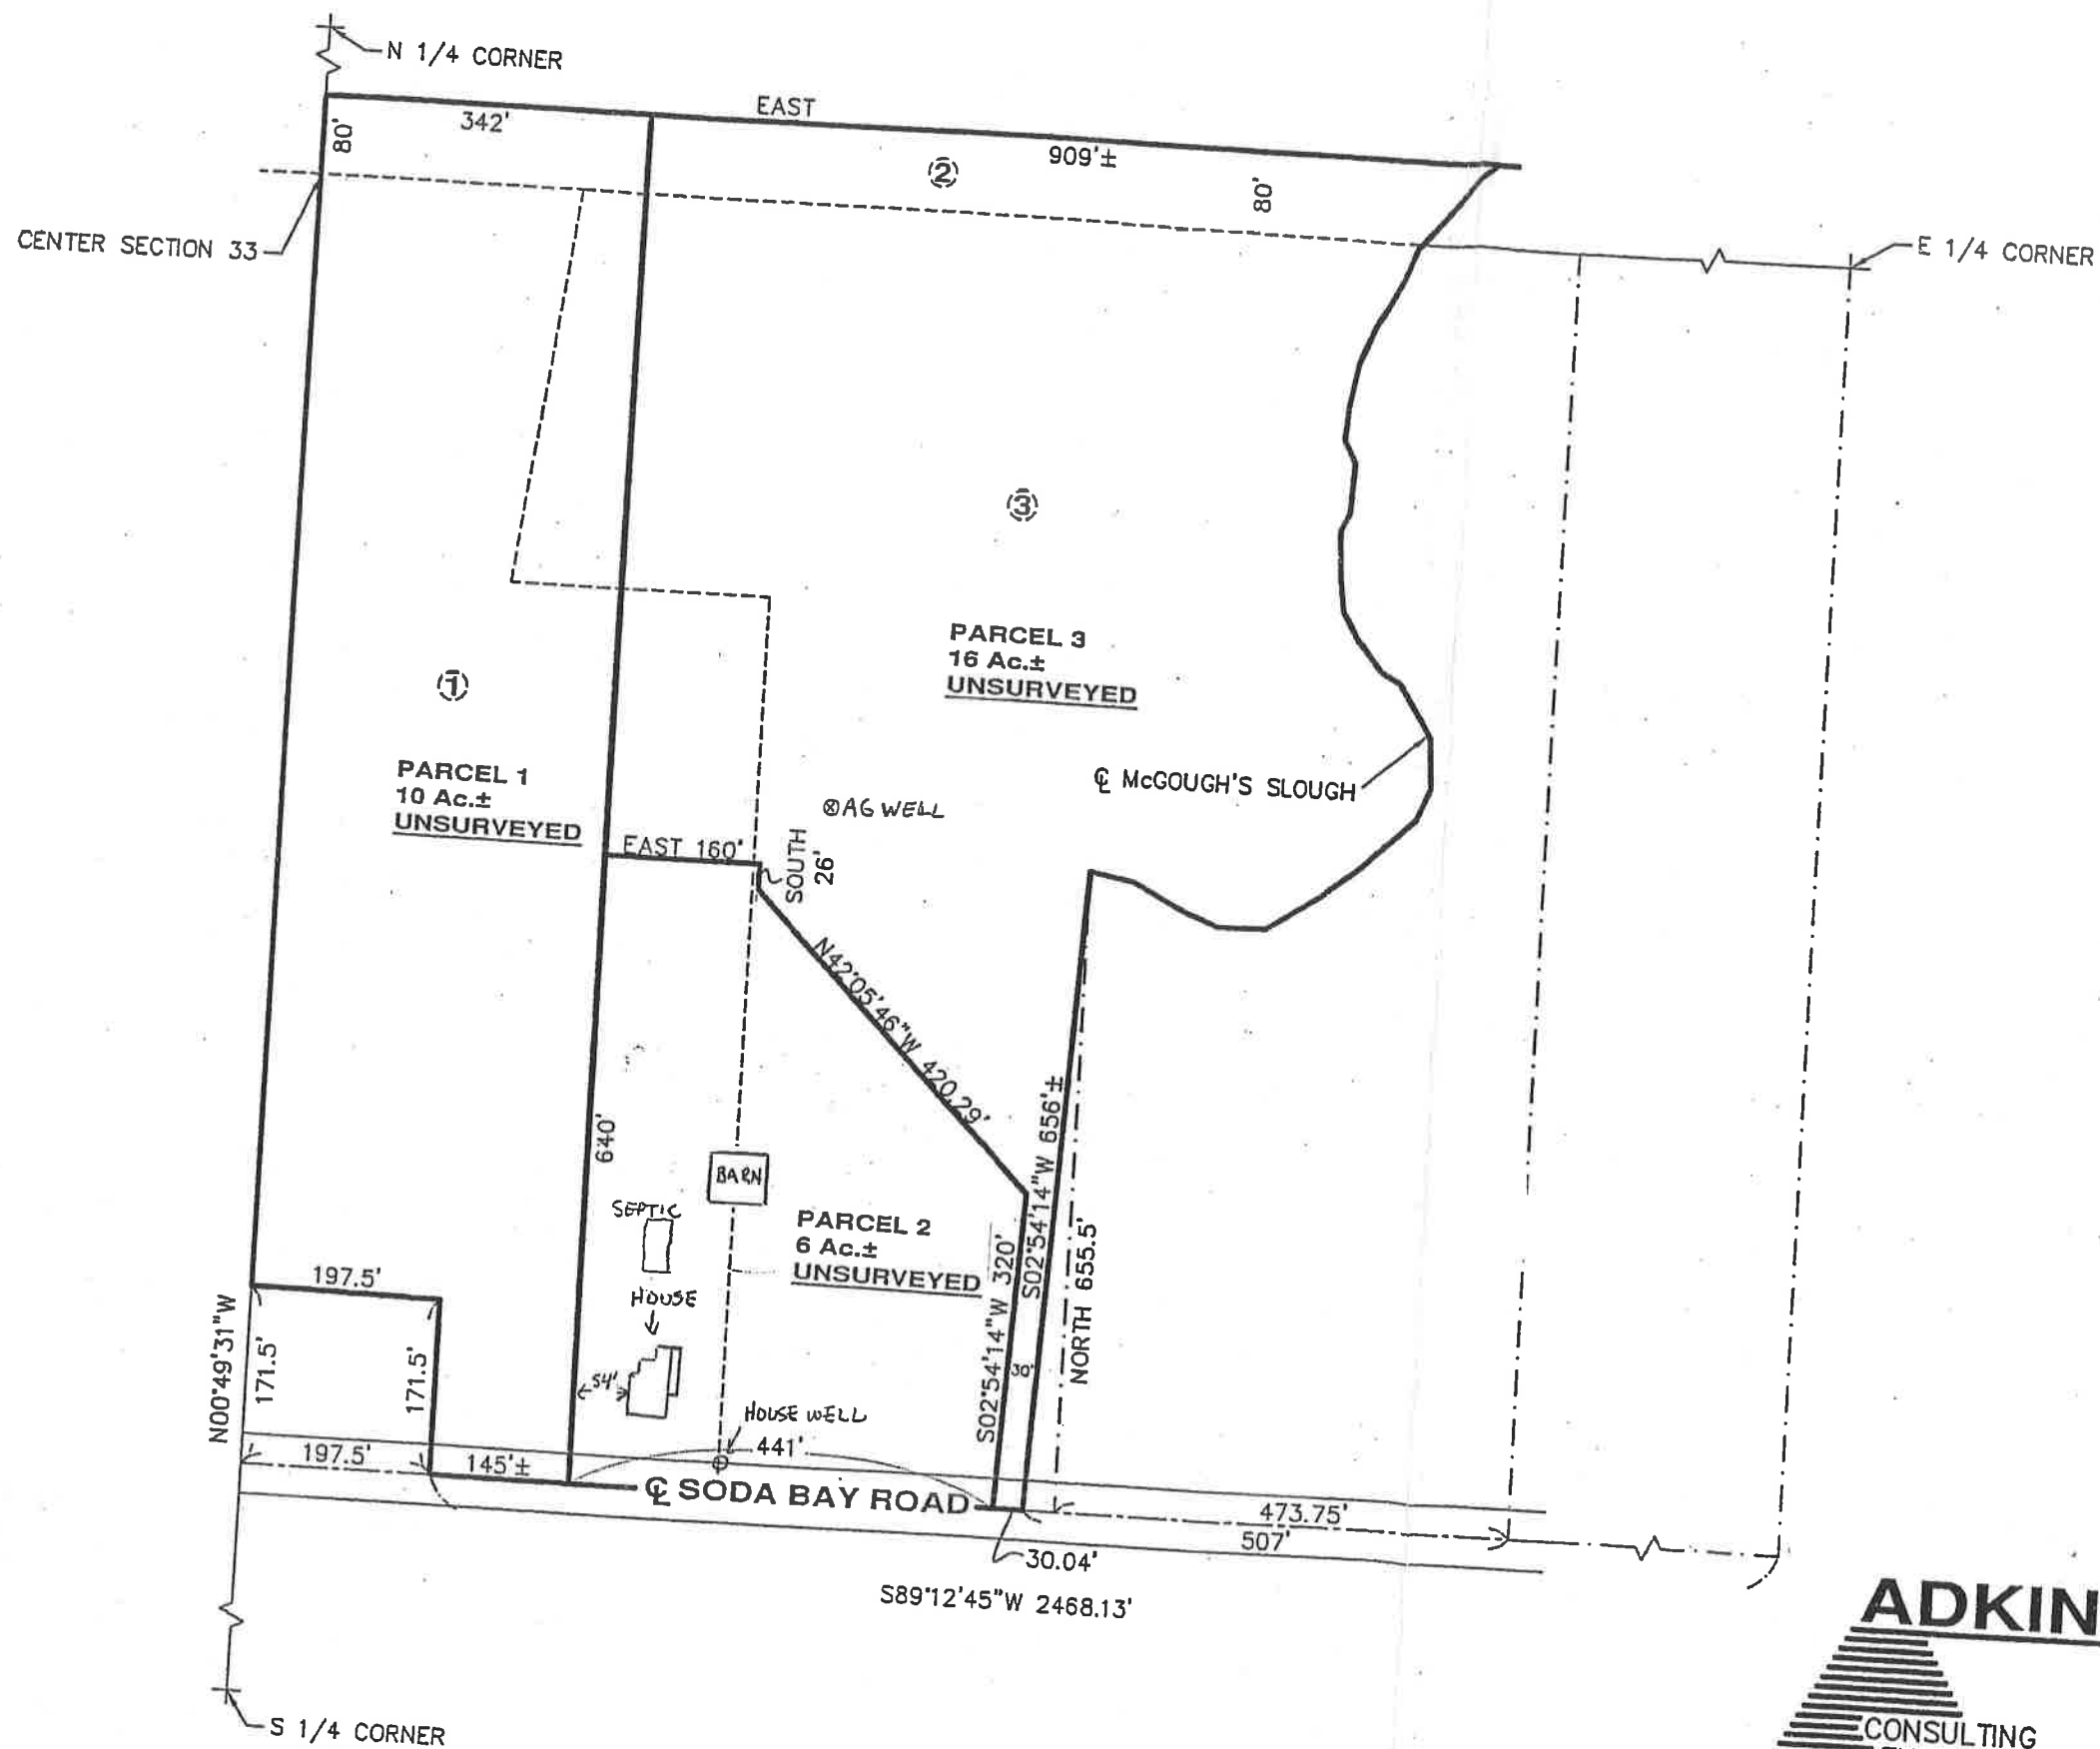

RECEIVED

NOV 16 2004

LAKE COUNTY COMMUNITY
DEVELOPMENT DEPT.



SCALE: 1" = 200'

PROPERTY INFORMATION

PROPERTY OWNER: PAT AND
MICHELLE SCULLY
P.O. BOX 620
3275 STONE DRIVE
FINLEY, CA 95435

PROPERTY ADDRESS: 2550 SODA BAY ROAD
LAKEPORT, CA 95453

VEHICULAR ACCESS: FROM SODA BAY ROAD

EXISTING PARCELS

PARCEL 1 - 12 Ac.±, NO. 008-010-41
PARCEL 2 - 2 Ac.±, NO. 008-010-42
PARCEL 3 - 18 Ac.±, NO. 008-010-42

PROPOSED PARCELS

PARCEL 1 - 10 Ac.±
PARCEL 2 - 6 Ac.±
PARCEL 3 - 16 Ac.±

LEGEND

— PROPOSED PARCEL LINE
- - - EXISTING PARCEL LINE
(X) EXISTING PARCEL NUMBER

ADKINS

CONSULTING
ENGINEERS, INC.

2950 Shasta Way · Klamath Falls, Oregon 97603 · (541) 884-4666 · FAX (541) 884-5335
Klamath Falls, OR · Medford, OR · Alturas, CA

SEPTEMBER 2004